NOTES:

1. POINT OF CONNECTION IS THE TERMINAL OF SPT DISCONNECTOR 104.
2. ALL MAIN METERS CONNECTED TO DEDICATED CT & VT WINDINGS. CHECK METERS ARE CONNECTED TO CT & VT WINDINGS WITH ADDITIONAL EQUIPMENT FOR TURBINE SUPPLIER HPPP CONTROL.

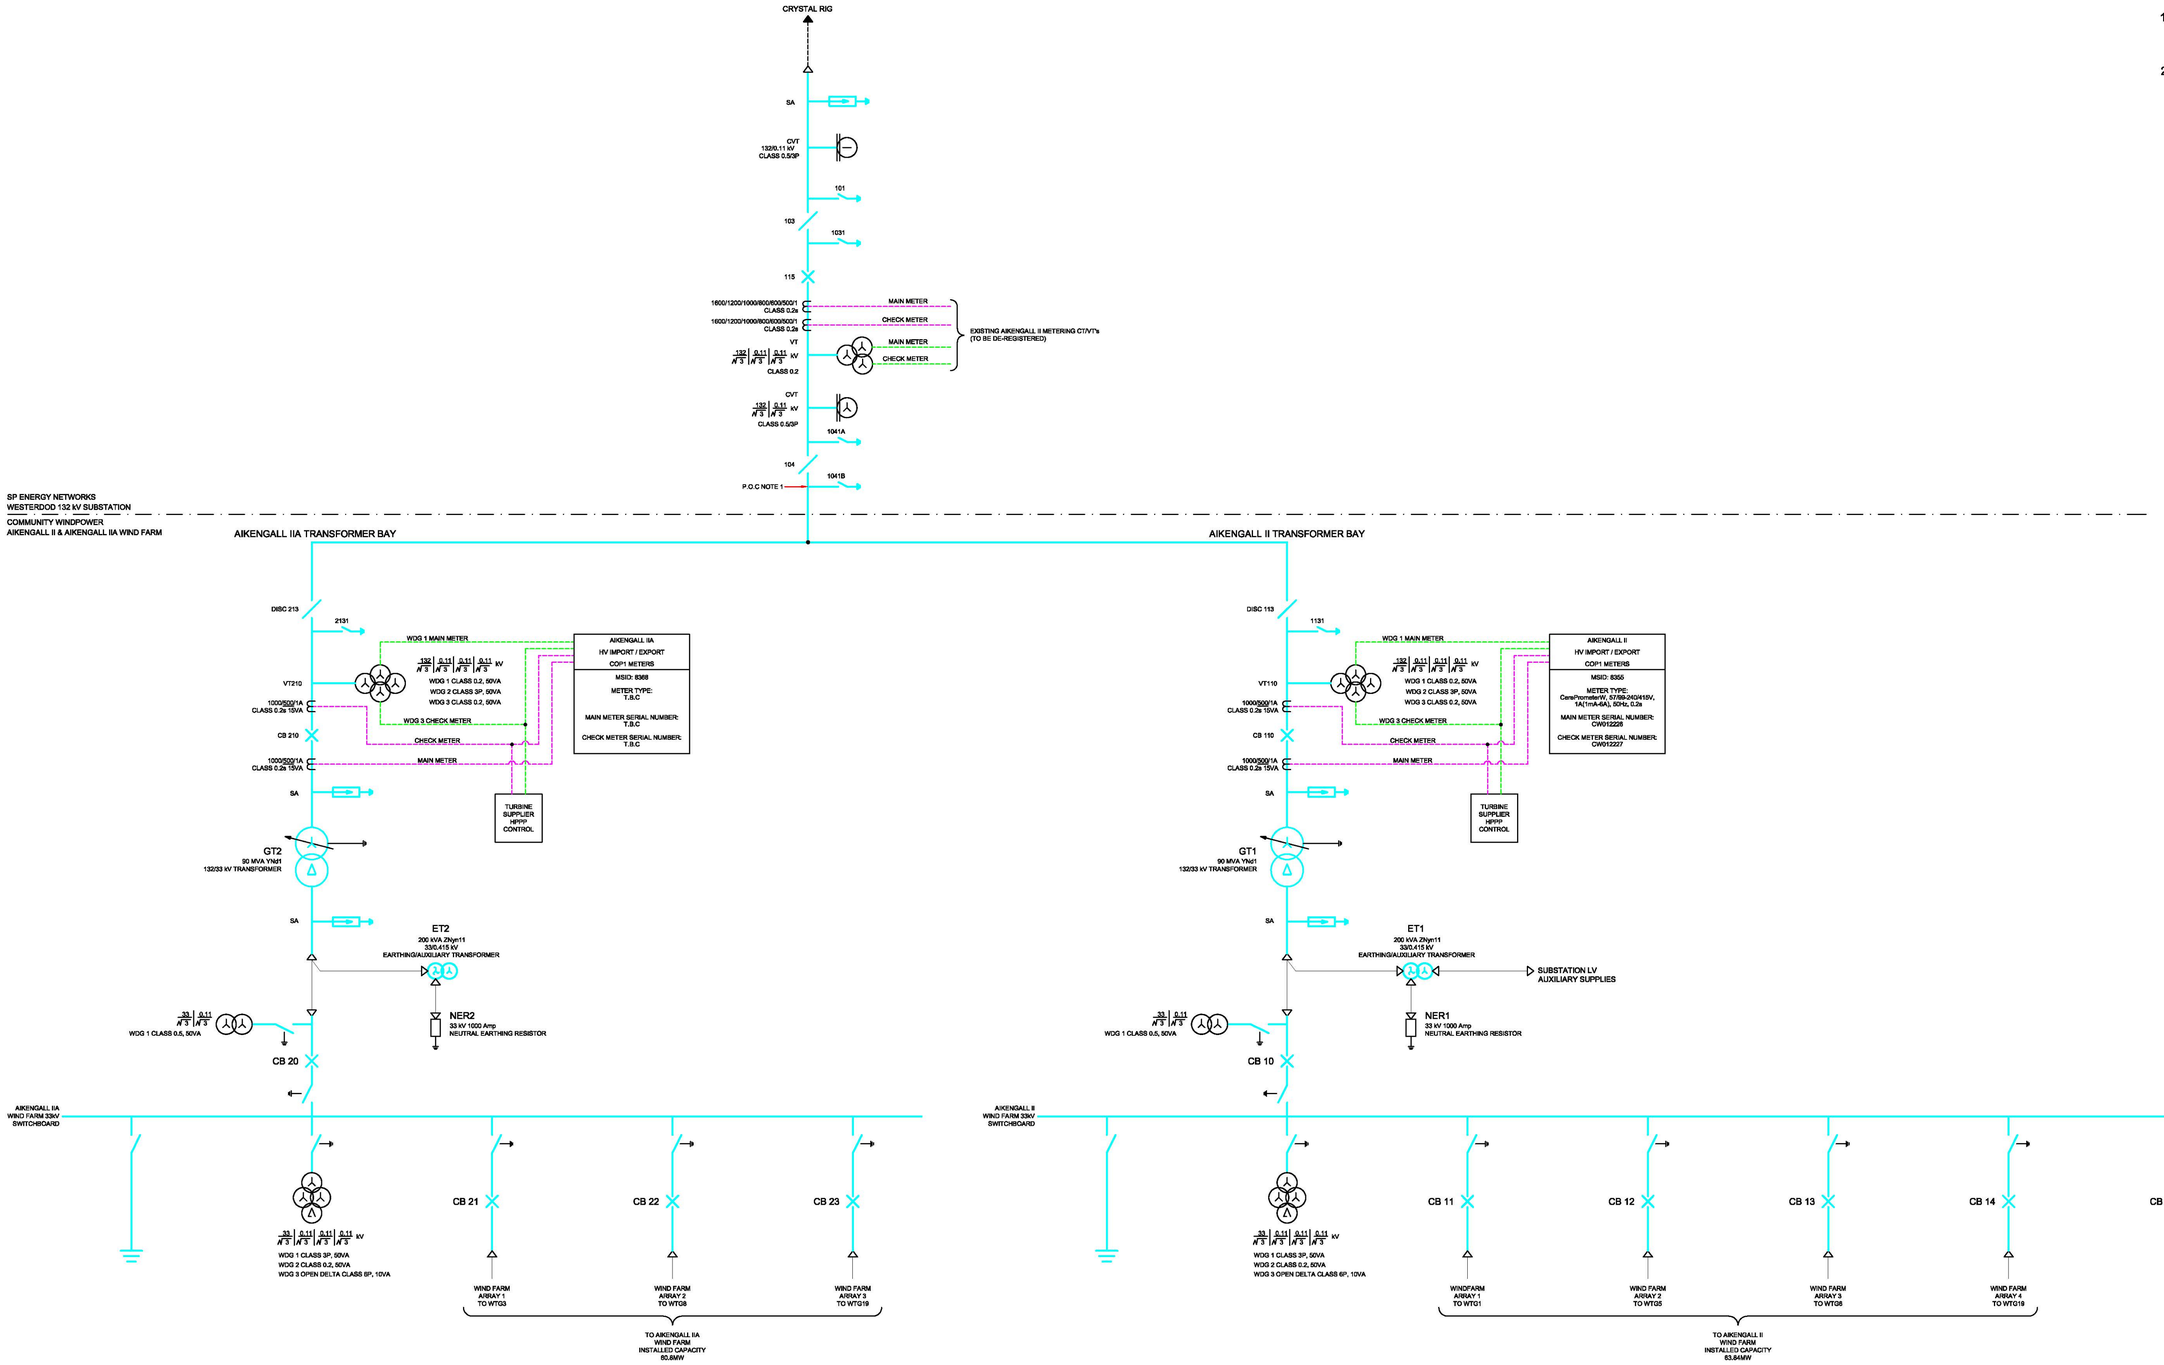

C	INCLUDED REFERENCE TO EXISTING AIKO METERING POINT	R.M.F.	R.M.F.	E.T.	04/11/19
B	REVISED AIKENGALL IIA INSTALLED CAPACITY	R.M.F.	R.M.F.	E.T.	31/10/19
A	INITIAL ISSUE	S.A.M	R.M.F	E.T	30/09/19
Issue	Description	Drawn	Checked	Appr'd	Date

POWERSYSTEMS
HIGH VOLTAGE SPECIALISTS
Badminton Road, Yate, Bristol, BS37 6GG
t: 01454 318000 www.powersystems.uk.com f: 01454 318111

Project Title
AIKENGALL IIA WIND FARM

Drawing Title
AIKENGALL II & IIA
HV METERING LOCATIONS

Scale	Original Size	Issue
N.T.S	A1	C

Drawing No.
15250-04

Sheet
1 of 1