



ELEXON

- 1.1 Graph 1 below provides an aggregated view of the total UMS error for both Q2 2021 and Q3 2021. The total gross error has been split into the total overstated and understated error for each quarter. The Settlement Dates that the snapshots for EAC values were taken on for Q2 2021 and Q3 2021 were 11 May 2021 and 11 August 2021, respectively.

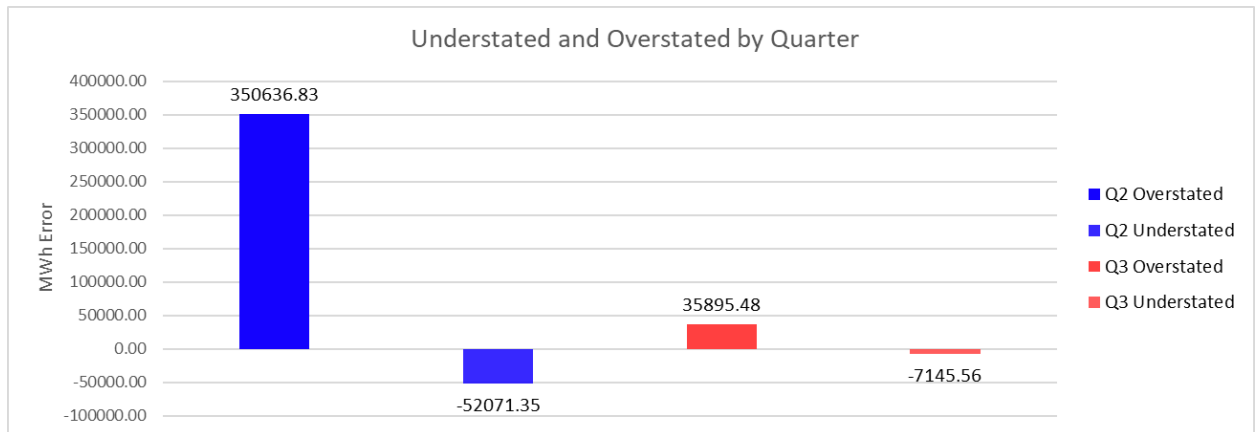


Graph 1 - Total overstated and understated UMS error for Q2 2021 and Q3 2021

- 1.2 Graph 2 below provides a breakdown of the total error that comprises Q2 2021 and Q3 2021. Specifically, the graph highlights the amount of error identified in Q3 2021 that is either new, or is pre-existing from Q2 2021.

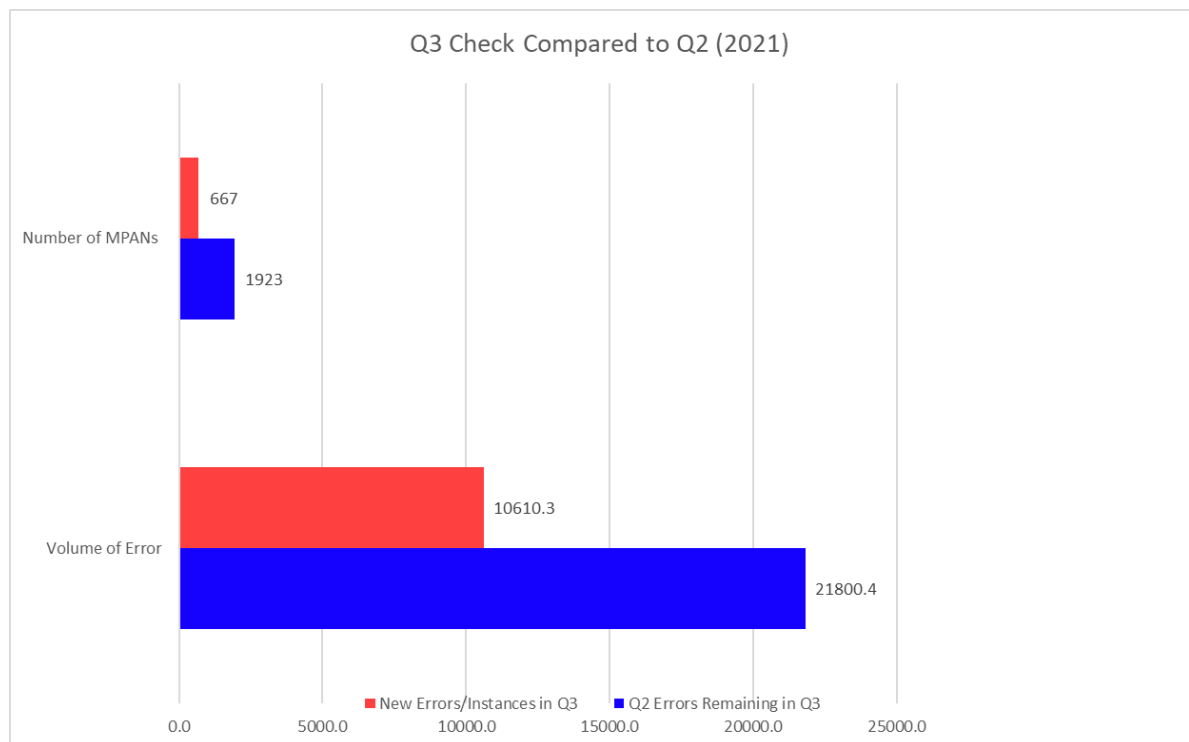


Graph 2 – New vs Old instances between Q2 2021 and Q3 2021

1.3 Graph 3 below provides a breakdown of the total error in Q3 2021 by Grid Supply Point (GSP) Group.

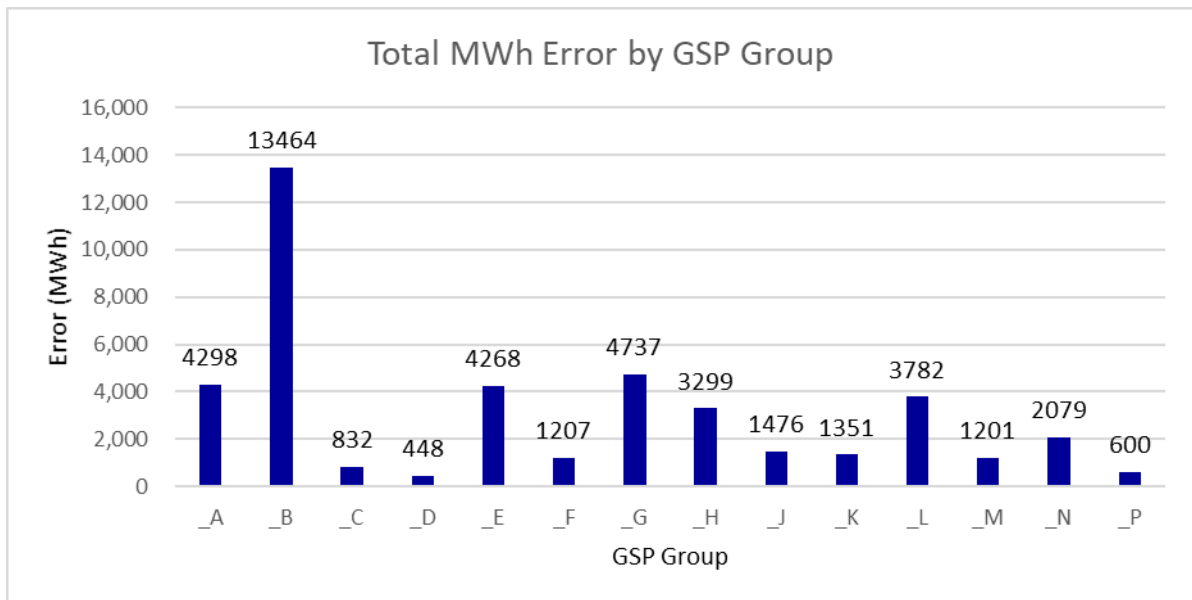


Graph 3 – Total error by GSP Group (Q3 2021)

1.4 Graph 4 below provides the five largest overstated and understated erroneous instances in the Q3 2021 period.

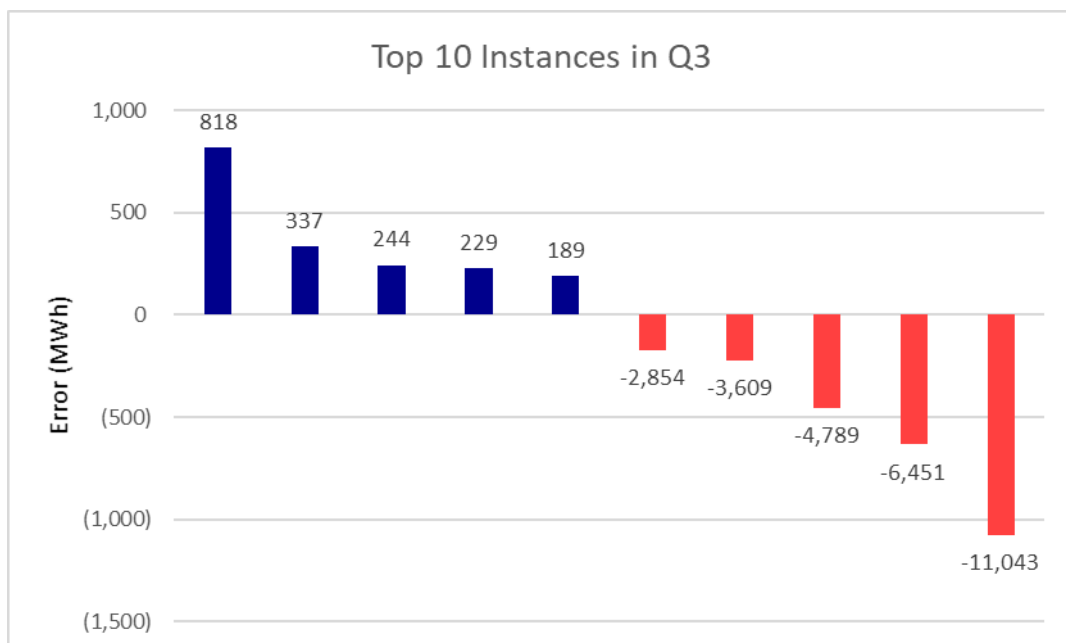


Graph 4 – Five largest overstated and understated errors (Q3 2021)

- 1.5 Graph 5 below provides a breakdown of the total error associated with each Supplier that appeared in the Q3 2021 reporting period (32 Suppliers)

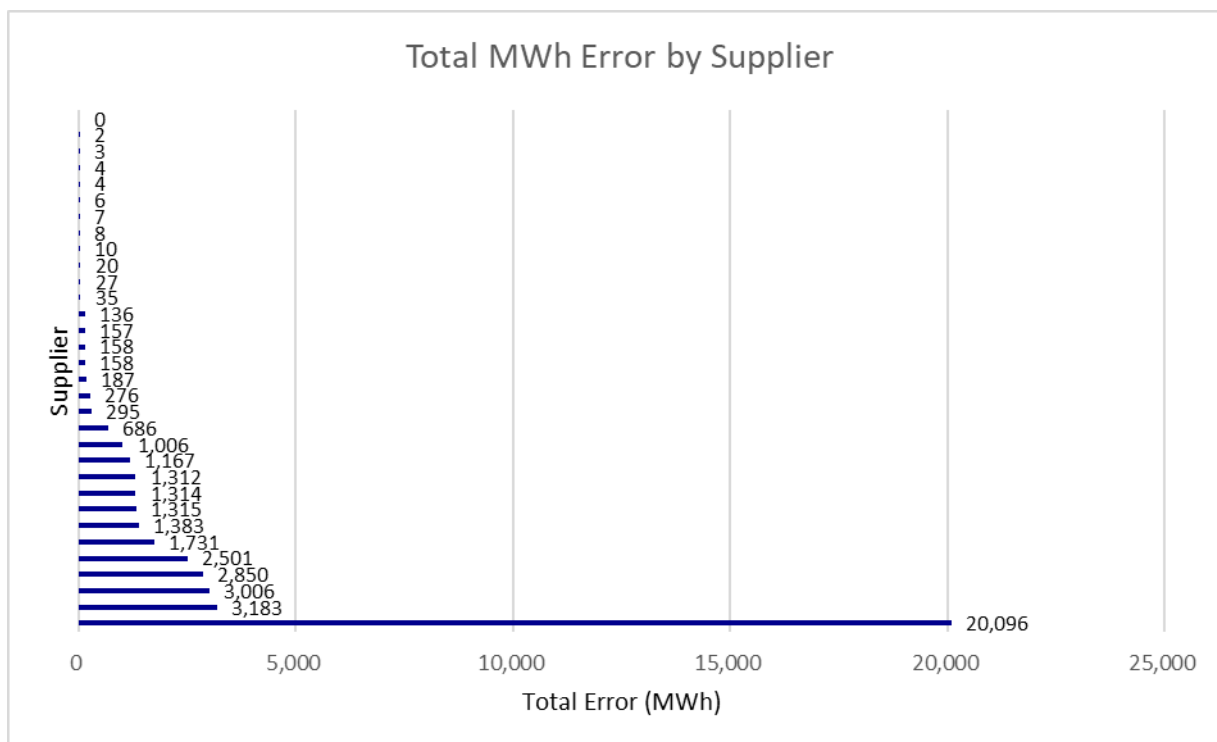

Graph 5 – Total error per Supplier (Q3 2021)

- 1.6 Graph 6 below provides a breakdown of the total error associated with each NHHDA that appeared in the Q3 2021 reporting period (19 NHHDA's)

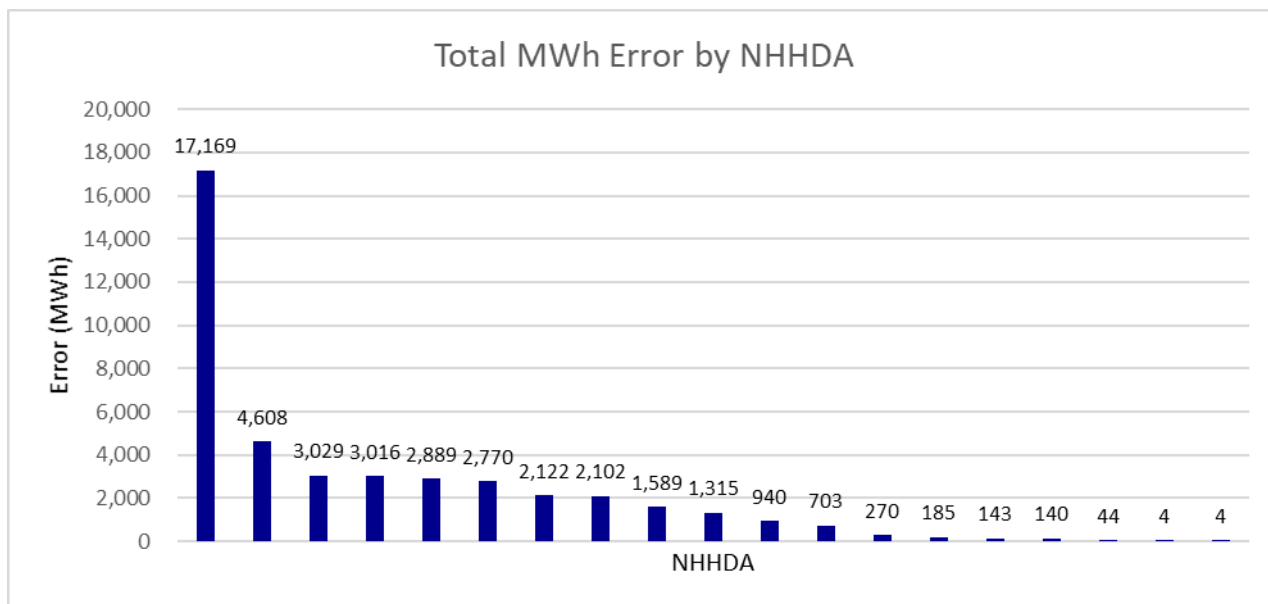

Graph 6 – Total error per NHHDA (Q3 2021)