

# ISG246-SPAR

Issue 69 - Published 13 September 2021

## System Price Analysis Report

The System Prices Analysis Report (SPAR) provides a monthly update on price calculations. It is published by the ELEXON Market Operations on the Elexon Website and issued to the Imbalance Settlement Group (ISG) at their monthly meeting.

This report provides data and analysis specific to System Prices and the Balancing Mechanism. It demonstrates the data used to derive the prices. The data is a combination of II and SF Settlement Runs.

### Reporting on August 2021

#### 1 System Prices and length

This report covers the month of August. Where available, data uses the latest Settlement Run (in most cases 'II' or 'SF'). In this report, we distinguish between a 'long' and a 'short' market when analysing System Prices, because the price calculation differs between the two scenarios.

When the market is long, System Prices are based predominantly on the System Operator's 'sell' actions such as accepted Bids. When the market is short, System Prices are based predominantly on the System Operator's 'buy' actions.

##### System Price summary by month (£/MWh)

This table gives a summary of System Prices for August, with values shown in £/MWh.

System Length	Min	Max	Median	Mean	Std.Dev
Long	-18.66	110.66	62.00	58.80	19.15
Short	65.00	200.18	132.00	135.32	15.38

Source: Elexon


##### Frequency of System Prices over last month

This graph shows the distribution of System Prices across Settlement Periods in August 2021 when the market was long and short. 80% of System Prices were between £53.73/MWh and £152.00/MWh regardless of system length. When the system was long, 80% of prices were between £35.11/MWh and £77.62/MWh. When the system was short, 80% of prices were between £119.90/MWh and £155.00/MWh.



1.2 Frequency of System Prices over last month

System Length ● Long ● Short

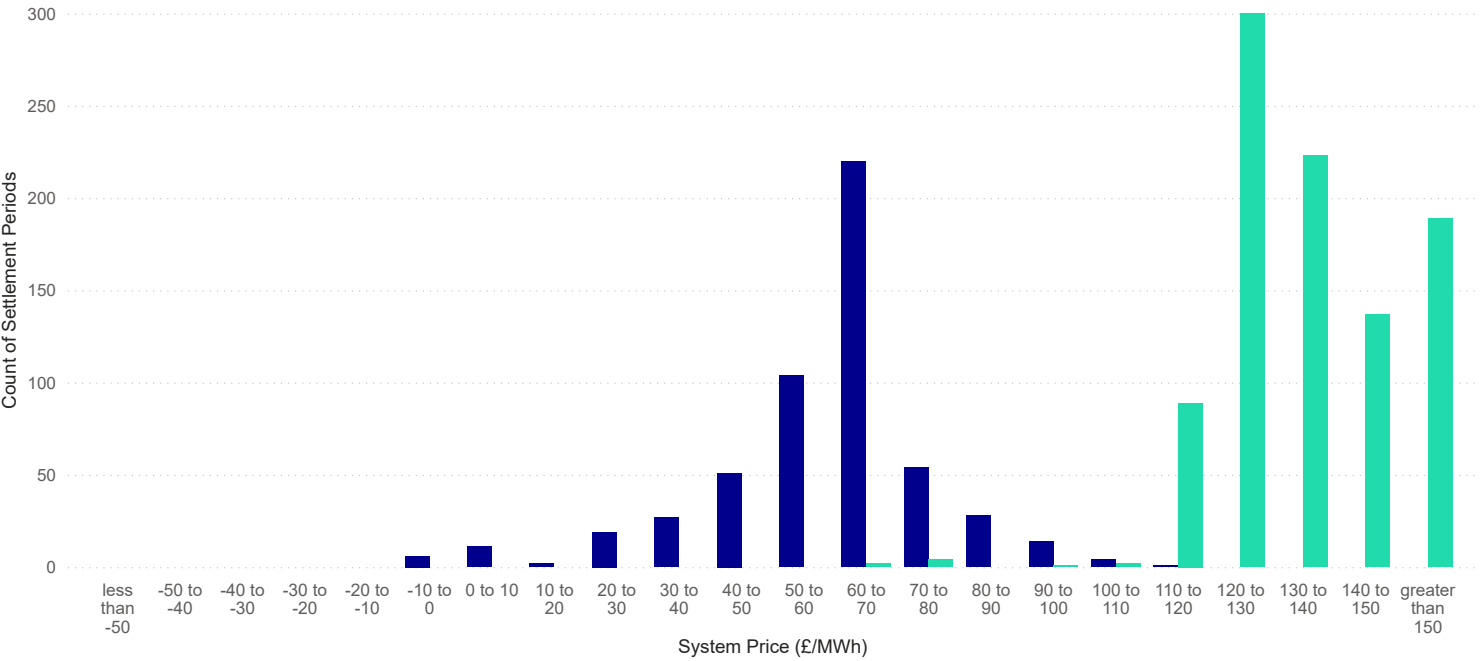

Microsoft Power BI




System Prices were £100.00/MWh or more on 945 occasions and £150.00/MWh or more on 189 occasions in August 2021. In the previous month there were 786 System Prices on or over £100.00/MWh and 34 System Prices on or over £150.00/MWh; the highest number of System Prices exceeding both thresholds since the implementation of BSC Modification P305 (<https://www.elexon.co.uk/modproposal/p305/>) on 5 November 2015.

The highest System Price of the month, £200.18/MWh, occurred in Settlement Period 37 on 19 August. The price was set by an Offer from a Supplier BM Unit priced at £200.18/MWh.

There were 13 Settlement Periods where the System Price was less than £0.00/MWh in August, with the lowest System Price of -£18.66/MWh occurring in Settlement Period 11 on 8 August. The price was set by a Balancing Services Adjustment Action (BSAA) priced at -£18.66/MWh.

**System Price spread** The graph below displays the spread of System Prices in August 2021 as a box plot diagram, split between a short and long system.

### 1.3 System Price spread

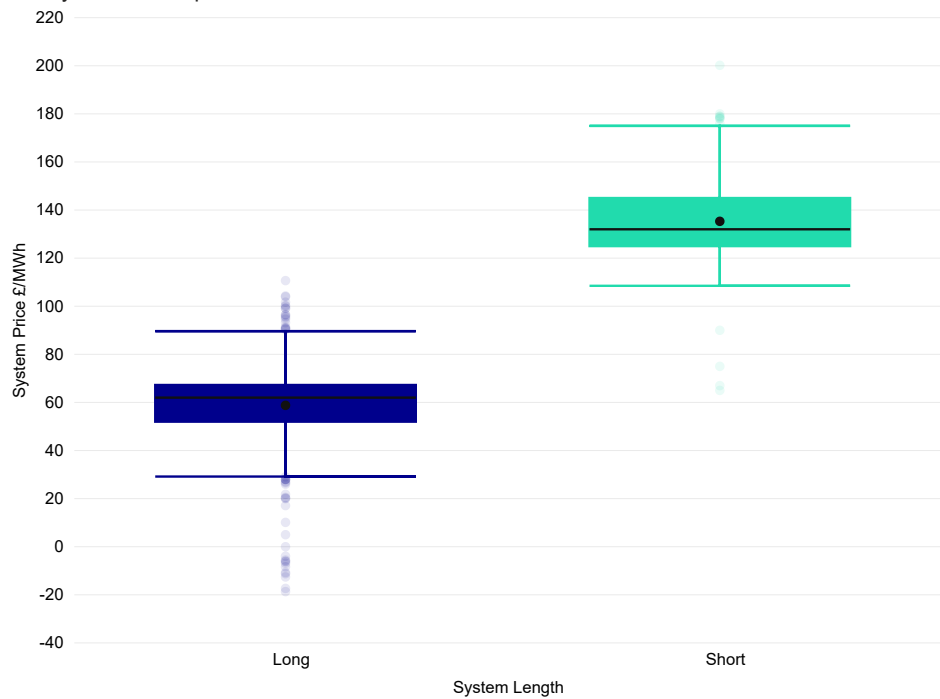

Microsoft Power BI



The middle line in each box represents the median System Price of the month, which is £132.00/MWh for short Settlement Periods and £62.00/MWh for long Settlement Periods. Each box edge represents the lower and upper quartiles (25th and 75th percentile respectively), with the Interquartile Range (difference between the Upper and Lower quartiles) being £20.00/MWh for short System Prices and £15.26/MWh for long System Prices.


Outliers are shown on the graph as circles, and have been defined as being greater than 1.5 times the Interquartile Range (IQR) away from the Upper and Lower quartiles. Under this definition, 55 long and 24 short System Prices in August were outliers. Of the 55 long outliers, 36 were less than the lower outlier boundary. The prices of Long outliers ranged from -£18.66/MWh (the lowest System Price of the month) to £110.66/MWh. The highest System Price of the month, £200.18/MWh, was 1.5 times the median short System Price for the month.

### Daily average System Price

The graph below shows daily average System Prices over the last month.

### 1.4 Daily average System Price

System Length ● Long ● Short

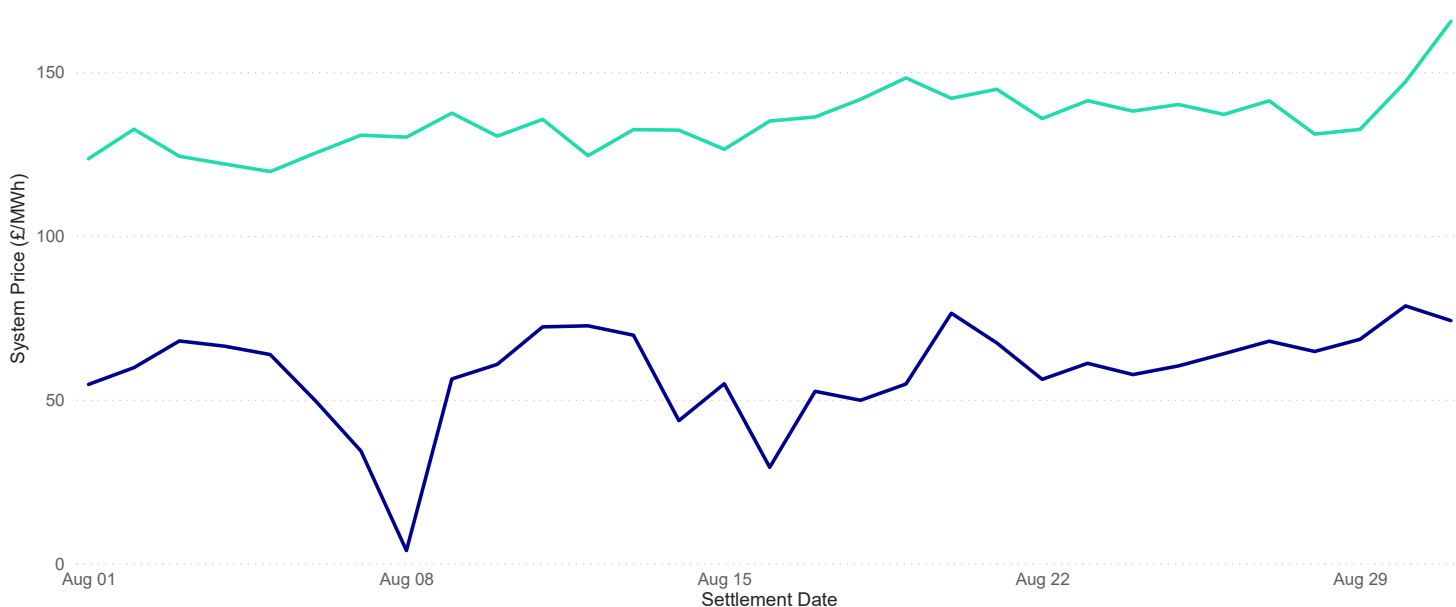

Microsoft Power BI




In August, the average System Price was £58.80/MWh when the system was long and £135.32/MWh when the system was short. The highest daily average price when the system was short was £165.51/MWh, and occurred on 31 August; the system was short for 32 Settlement Periods on this day. The lowest daily average price when the system was long was £3.96/MWh on 8 August. The system was long for 18 Settlement Periods on this day.

### Average System Price by Settlement Period

The graph below shows the variation of average System Prices across the day.

### 1.5 Average System Price by Settlement Period

System Length ● Long ● Short

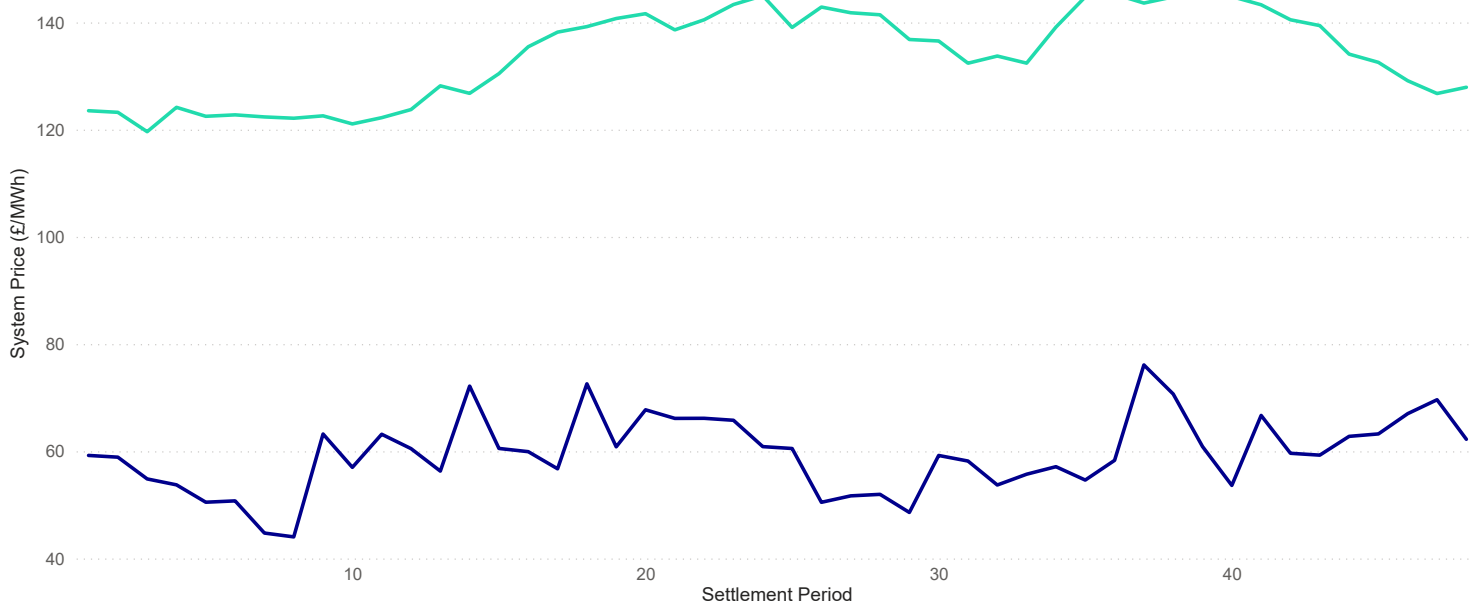

Microsoft Power BI



Short prices were highest in Settlement Period 39, with long prices lowest in Settlement Period 8. The lowest average System Price, regardless of market length, occurred during Settlement Period 46, when the System Price was £85.06/MWh. The daily average long Settlement Period System Prices ranged between £44.04/MWh and £76.11/MWh. Average short Settlement Period prices varied from £119.63/MWh to £146.58/MWh.


### Daily System Length

This graph shows system length by day.



1.6 System Length by day

System Length ● Long ● Short

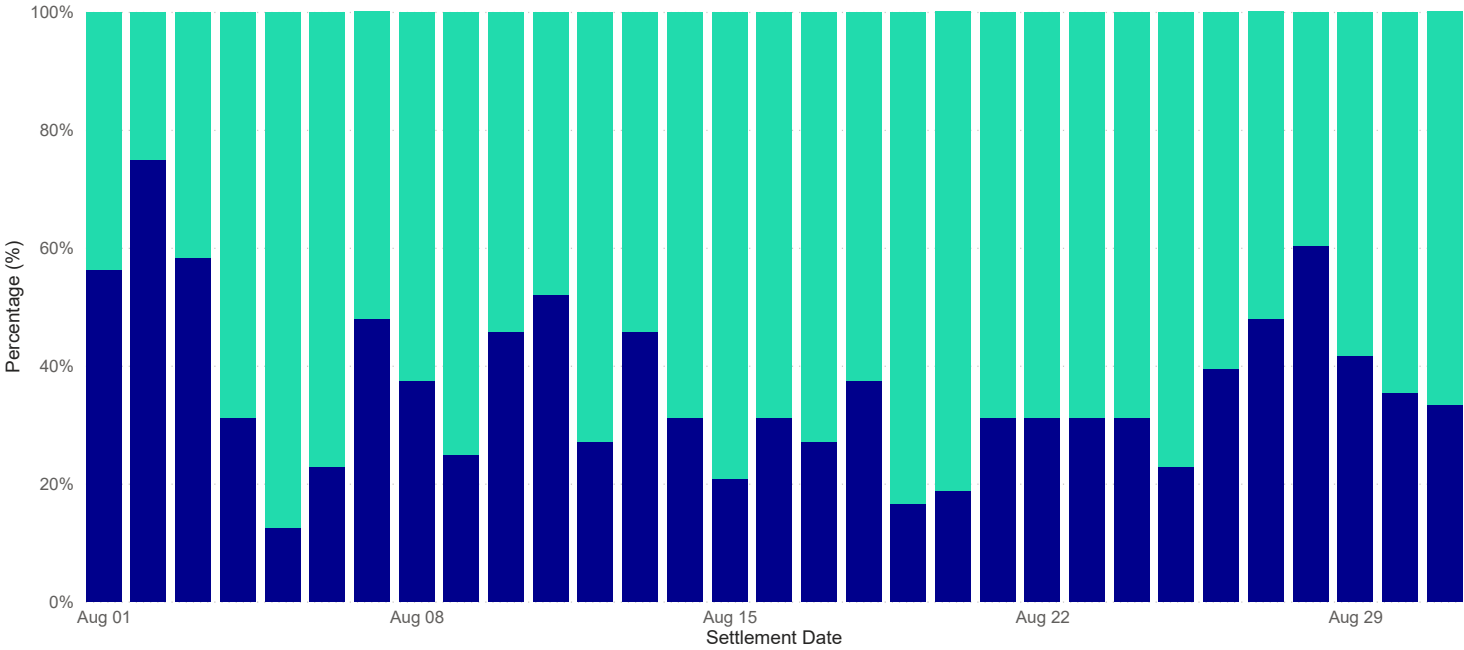


System Length by Settlement Period

This graph shows system length by Settlement Period for August.



1.7 System Length by Settlement Period

System Length ● Long ● Short

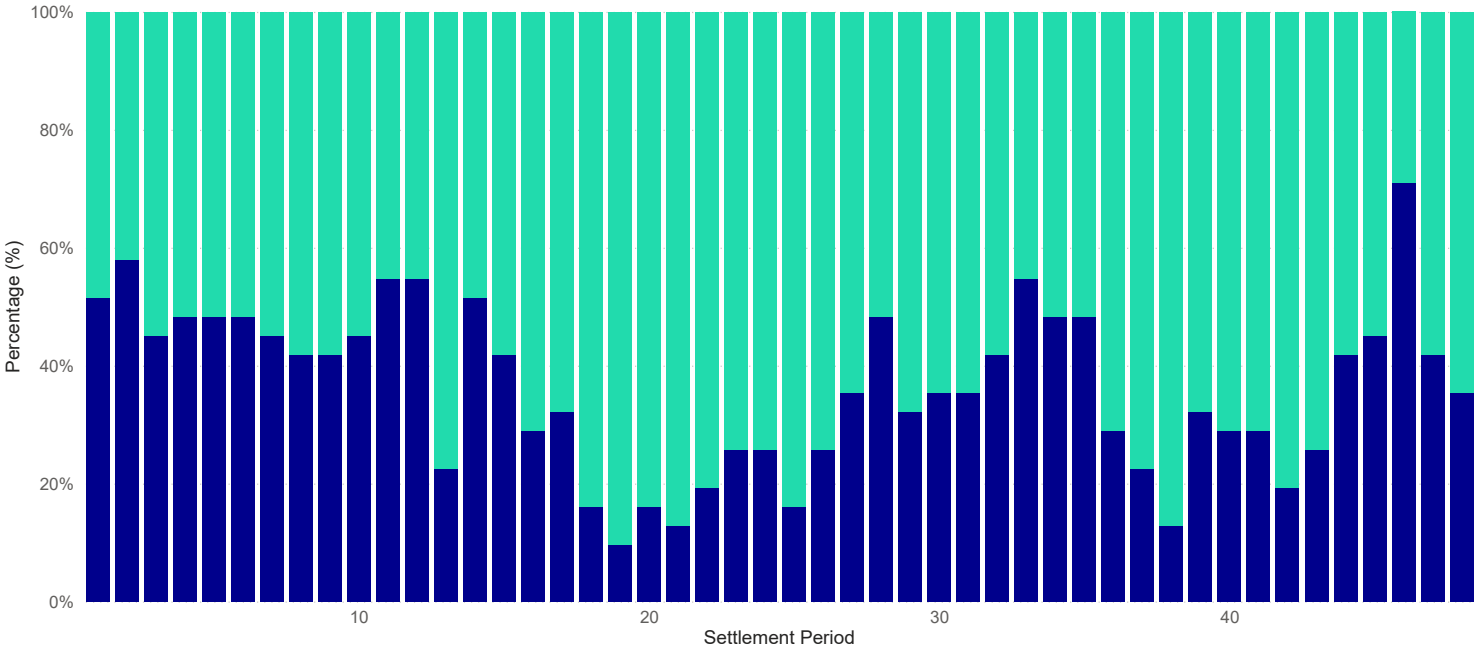

Microsoft Power BI



The system was long for 36% of Settlement Periods in August.

On 5 August, the system was short for 42 of 48 Settlement Periods. The long Settlement Periods on this day had an average NIV of -142MWh. The daily average NIV on this day was 280MWh.


Settlement Period 46 had the highest number of long Settlement Periods, with 71% of them being long this month.

Historic long vs short market

This graph shows the percentage of long and short Settlement Periods over the past year. August 2021 had 36% of long Settlement Periods, compared to 43% per month over the previous 12 months.



1.8 Historic Long vs Short Market

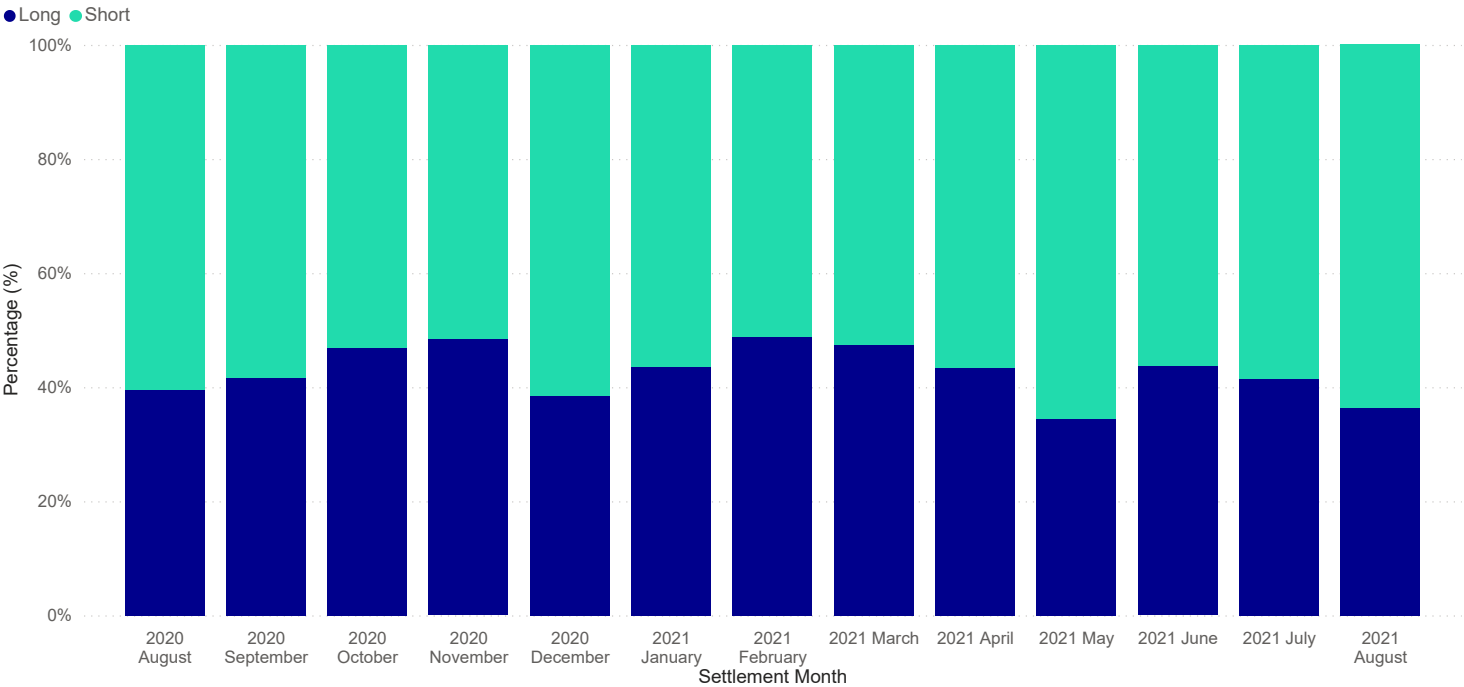


Average Daily System Price when Long by Settlement Day

The graph below displays the daily average System Prices in August 2021 when the system was long compared to the two previous months and the same month last year.



### 1.9 Average Daily System Price when Long by Settlement Day

Month ● Aug 20 ● Aug 21 ● Jul 21 ● Jun 21

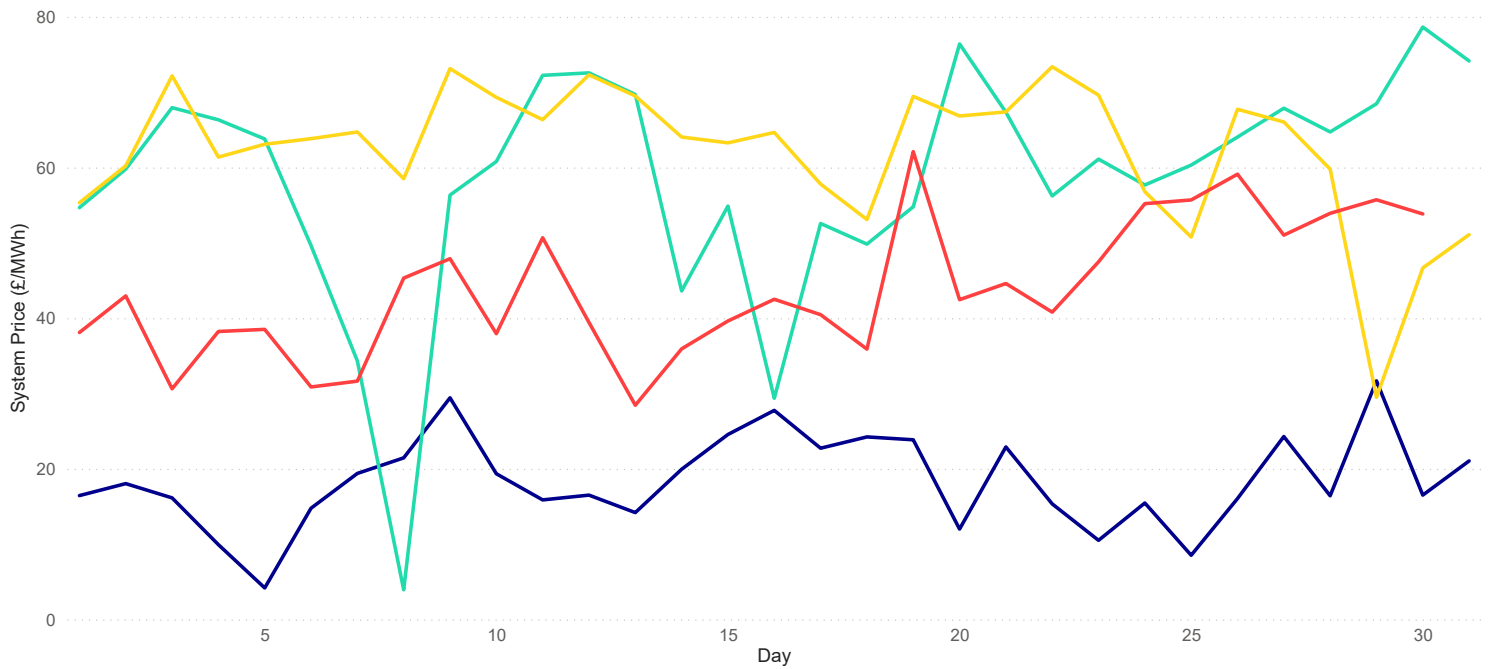

Microsoft Power BI




Daily average long System Prices were £40.14/MWh higher in August 2021 than the same month in 2020. The 8 August was the only day with a lower daily average long System Price than the same day in 2020.

### Average Daily System Price when Short by Settlement Day

This graph looks at System Prices from the same months as the previous graph, but when the System was short.

### 1.10 Average Daily System Price when Short by Settlement Day

Month ● Aug 20 ● Aug 21 ● Jul 21 ● Jun 21

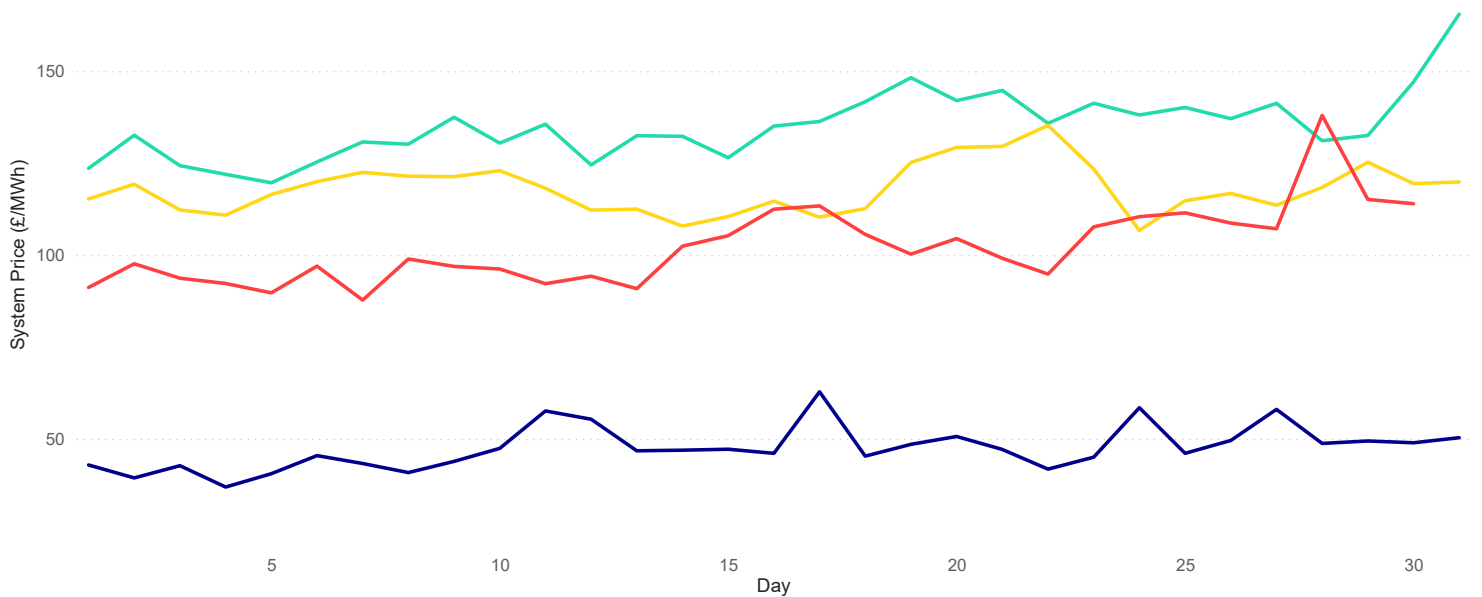

Microsoft Power BI




Short daily average System Prices were £87.46/MWh higher in August 2021 than the same month last year.

### Accepted Volumes Accepted Offer Volume by Fuel Type

This graph displays the Offer volumes of fuel types that participated in the Balancing Mechanism during August 2021. Offers are balancing actions taken to increase the level of energy on the System. This report now contains balancing volumes from Balancing Services Adjustment Actions (BSAAs). BSAAs include, but are not limited to, balancing actions such as system-to-system services, Short Term Operating Reserve actions taken outside the Balancing mechanism and forward contracted energy products.

### 1.11 Accepted Offer Volume by Fuel Type

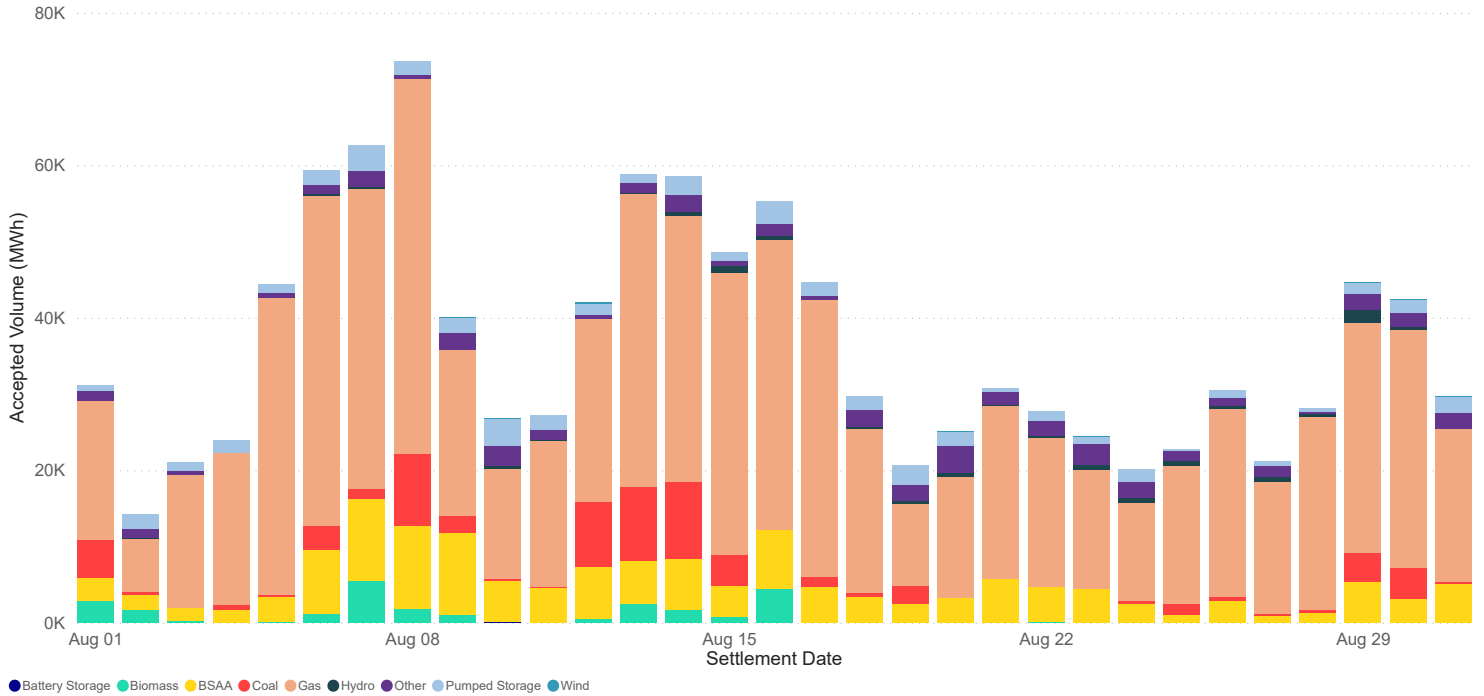


Microsoft Power BI



### Accepted Bid Volume by Fuel Type

This graph displays the Bid volumes of fuel types that participated in the Balancing Mechanism during August 2021. Bids are balancing actions taken to decrease the level of energy on the System.

1.12 Accepted Bid Volume by Fuel Type

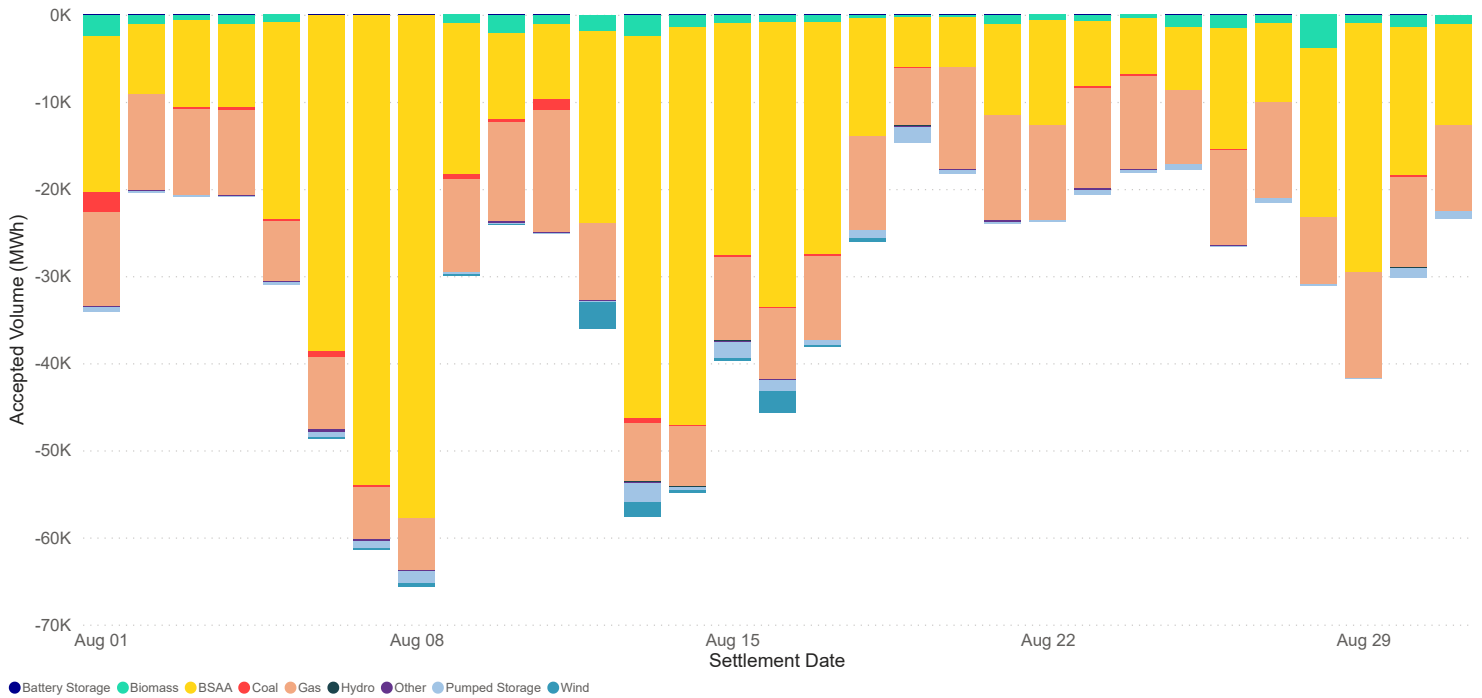

Microsoft Power BI



During August, 69% of Offer volume came from Gas BMUs with a further 13% from BSAA and 6% from Coal BMUs.  
62% of Bid volume came from BSAA BMUs with a further 30% from Gas and 3% from Biomass BMUs.

## 2 Parameters

In this section, we consider a number of different parameters on the price. We consider:

- The impact of Flagging balancing actions;
- The impact of the Replacement Price;
- The impact of NIV Tagging;
- The impact of PAR Tagging;
- The impact of DMAT and Arbitrage Tagging; and
- How these mechanisms affect which balancing actions feed into the price.

### Flagging

The Imbalance Price calculation aims to distinguish between ‘energy’ and ‘system’ balancing actions. Energy balancing actions are those related to the overall energy imbalance on the system (the ‘Net Imbalance Volume’). It is these ‘energy’ balancing actions which the Imbalance Price should reflect. System balancing actions relate to non-energy, system management actions (e.g. locational constraints).

Some actions are ‘Flagged’. This means that they have been identified as potentially being ‘system related’, but rather than removing them completely from the price calculation (i.e. Tagging them) they may be re-priced, depending on their position in relation to the rest of the stack (a process called Classification). The System Operator (SO) flags actions when they are taken to resolve a locational constraint on the transmission network (SO-Flagging), or to correct short-term increases or decreases in generation/demand (Continuous Acceptance Duration Limit (CADL) Flagging).


#### Daily volume of SO-Flagged/non-Flagged actions

This graph shows the volumes of Buy and Sell actions in August 2021 that have been Flagged by the SO as being constraint related. On 12 August, 70% of Sell volume was SO-Flagged.



2.1 Daily volume of SO Flagged/non SO Flagged actions

Type ● Non SO Flagged Buy ● Non SO Flagged Sell ● SO Flagged Buy ● SO Flagged Sell

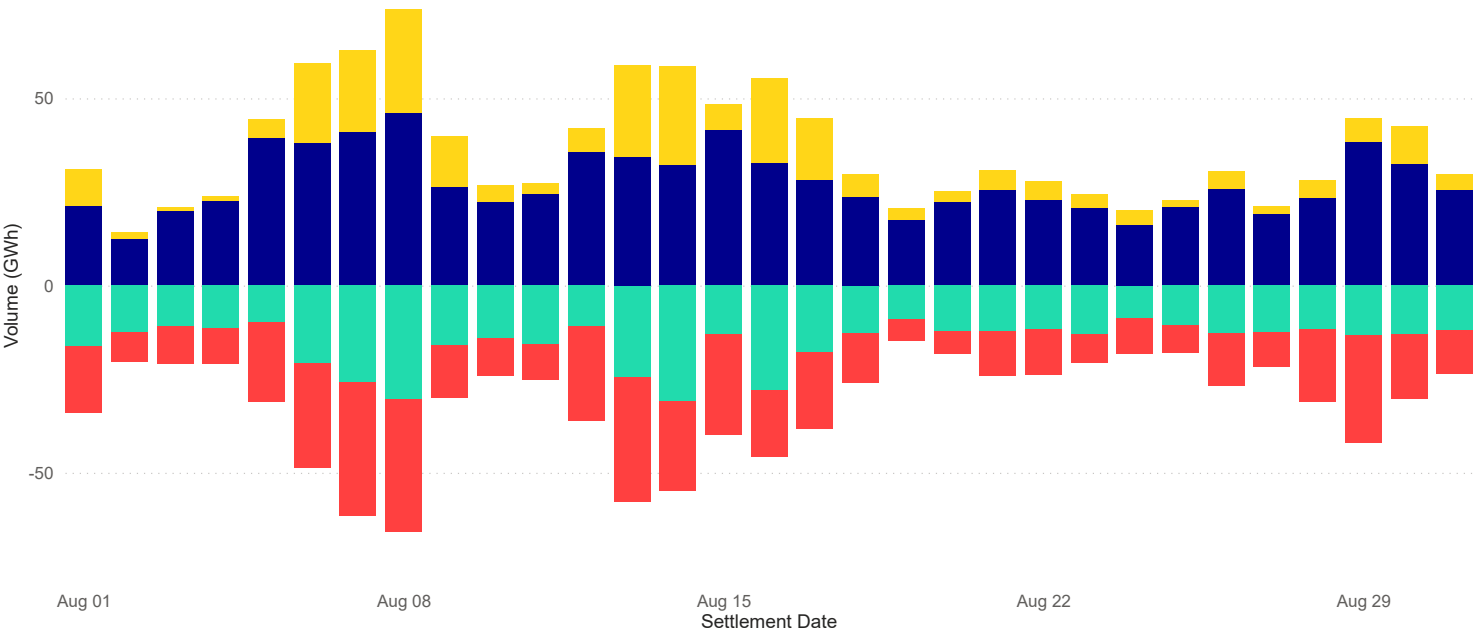

Microsoft Power BI



52% of Sell balancing action volume taken in August had an SO-Flag, compared with 56% the previous month. 2% of SO-Flagged Sell actions came from CCGT BMUs, 97% came from Balancing Service Adjustment Actions (BSAAs) and 1% from Wind BMUs. The average initial price (i.e. before any re-pricing) of a SO-Flagged Sell action was £42.39/MWh.

24% of Buy balancing action volume taken in August had an SO-Flag, compared to 16% in July. 52% of SO-Flagged Buy actions came from CCGT BMUs and 34% from BSAAs. The average initial price of a SO-Flagged Buy action was £148.79/MWh.

Any actions with a total duration of less than the CADL are flagged. The CADL is currently set at 10 minutes.

0.4% of Buy action volume and 0.4% of Sell action volume were CADL Flagged in August. The majority of CADL Flagged Buy actions (99%), and CADL Flagged Sell actions (59%) came from Pumped Storage BMUs, with CCGT BMUs accounting for a further 8% of CADL Flagged Sell Actions.


SO-Flagged and CADL Flagged actions are known as 'First-Stage Flagged'. First-Stage Flagged actions may become 'Second-Stage Flagged' depending on their price in relation to other Unflagged actions. If a First-Stage Flagged balancing action has a more expensive price than the most expensive First-Staged Unflagged balancing action, it becomes Second-Stage Flagged. This means it is considered a system balancing action and becomes unpriced.

Flagged Balancing Volumes


This graph shows First and Second-Stage Flagged action volumes as a proportion of all actions taken on the system. Note these are all the accepted balancing actions – only a proportion of these will feed through to the final price calculation.

In August, 35% of balancing volume received a First-Stage Flag with 24% of this volume going on to receive a Second-Stage Flag. On the 13 August, 50% of balancing volume was flagged; with 23% of this volume receiving a Second Stage Flag.

2.2 Flagged volume percentage

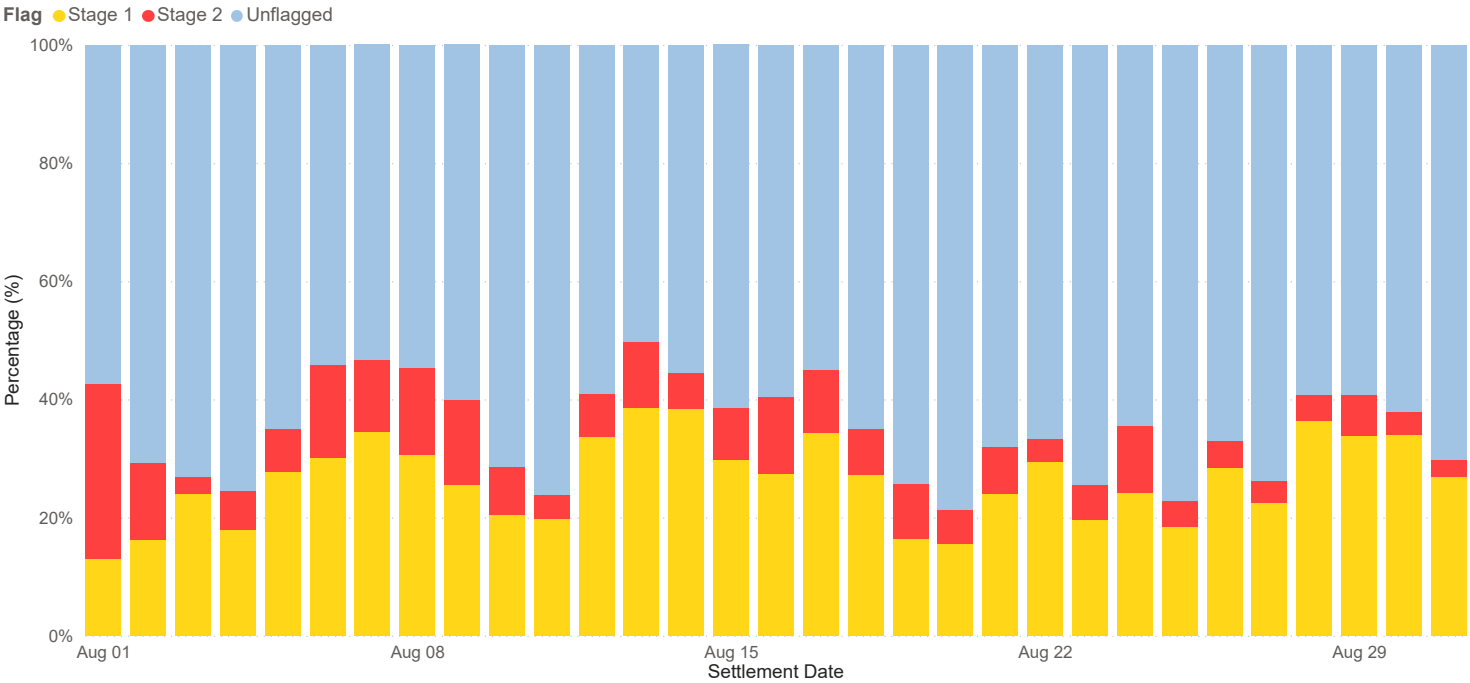

Microsoft Power BI



The Replacement Price


Any Second-Stage Flagged action volumes left in the NIV will be repriced using the Replacement Price. The Replacement Price is either based on the Replacement Price Average Reference (RPAR currently based on the most expensive 1MWh of Unflagged actions), or if no Unflagged actions remain after NIV Tagging, the Market Index Price (MIP). In August, 7 (0%) Settlement Periods had a Replacement Price based on the RPAR and 2 (0%) Settlement Periods had a Replacement Price based on the MIP. However, the majority of Settlement Periods (99%) did not have a Replacement Price.

**Number of Settlement Periods with Replacement Price by System Length** displays the count of Settlement Periods which had a Replacement Price applied, split by the system length and if the Replacement Price was based on RPAR or the MIP.



2.3 Number of Settlement Periods with Replacement Price by System Length

Replacement Price Type ● MIP ● RPAR

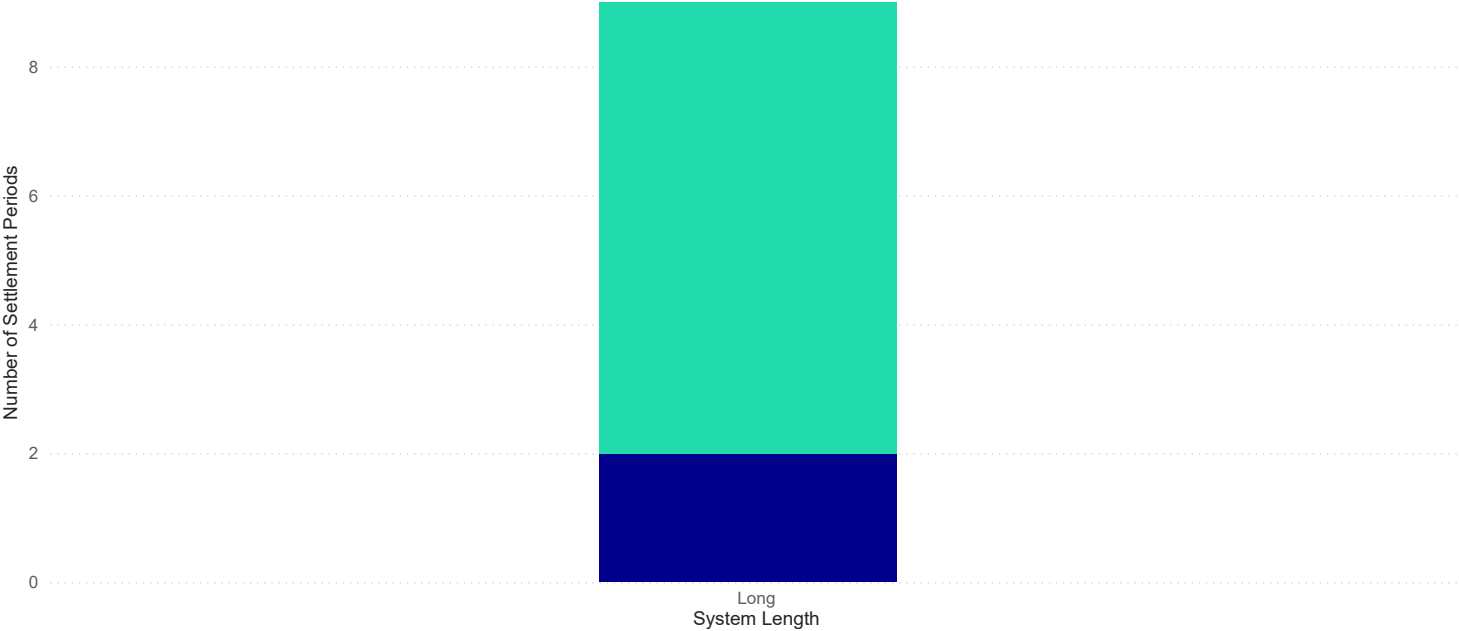

Microsoft Power BI



Average Price and Replacement Price by System Length

This table displays the average original and Replacement Price of Second-Stage Flagged actions

System Length	Original Price	Replacement Price
Long	48.66	60.33

Source: Elexon

Sell actions will typically have their prices revised upwards by the Replacement Price for the purposes of calculating the System Price. In total, 53% of Sell volume in August was Flagged. Of this Flagged Sell volume, 0.4% was assigned a Replacement Price. The average original price of a Second-Stage Flagged repriced Sell action was £48.66/MWh and the average Replacement Price for Sell actions (when the System was long) was £60.33/MWh.


25% of Buy volume was Flagged; none of this volume had the Replacement Price applied.

If there are no Unflagged actions remaining in the NIV, the Replacement Price will default to the MIP. This occurred in two long Settlement Periods in August, compared to three long Settlement Periods the previous month.

Monthly Average Long Price, Short Price and MIP

This graph compares the monthly average MIP to the monthly average long and short System Prices for the past 13 months. The monthly average long price decreased by -£2.60/MWh to £58.80/MWh, the short price increased by £16.38/MWh to £135.32/MWh and the MIP increased by £12.35/MWh to £106.26/MWh in August 2021 compared to the previous month. August

2021 saw the highest monthly average MIP, monthly average short System Price and the second highest monthly average long System Price since the implementation of BSC Modification P305 (<https://www.elexon.co.uk/modproposal/p305/>) on 5 November 2015.

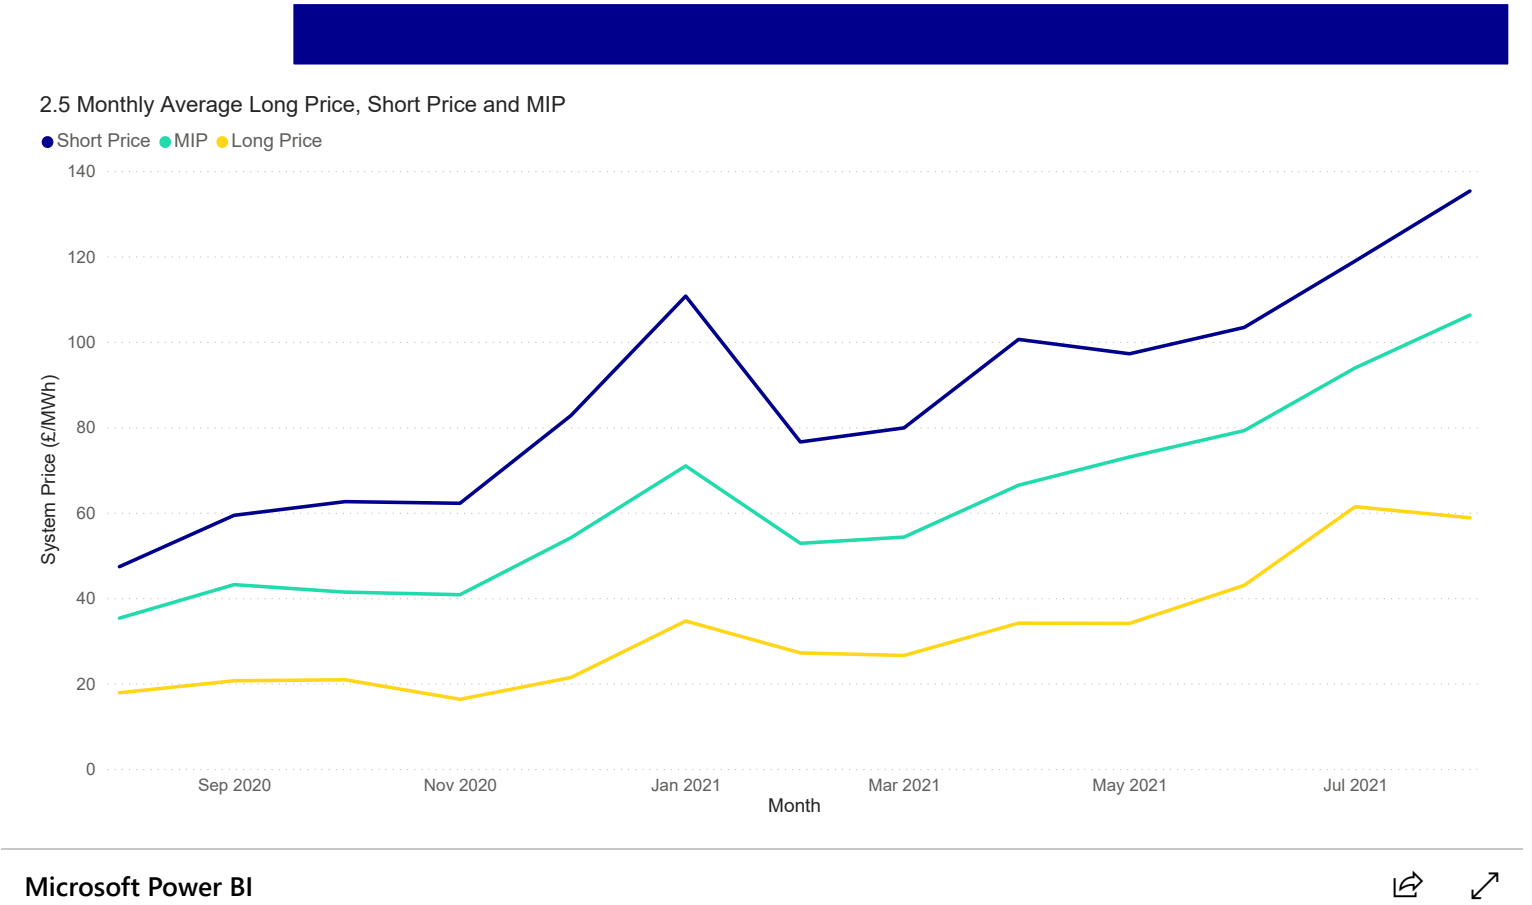

## NIV and NIV Tagging

The Net Imbalance Volume (NIV) represents the direction of imbalance of the system – i.e. whether the system is long or short overall.

### Short system NIV


This graph shows the greatest and average NIV when the system was short.





2.6 Short System NIV

● Average of NIV ● Max of NIV

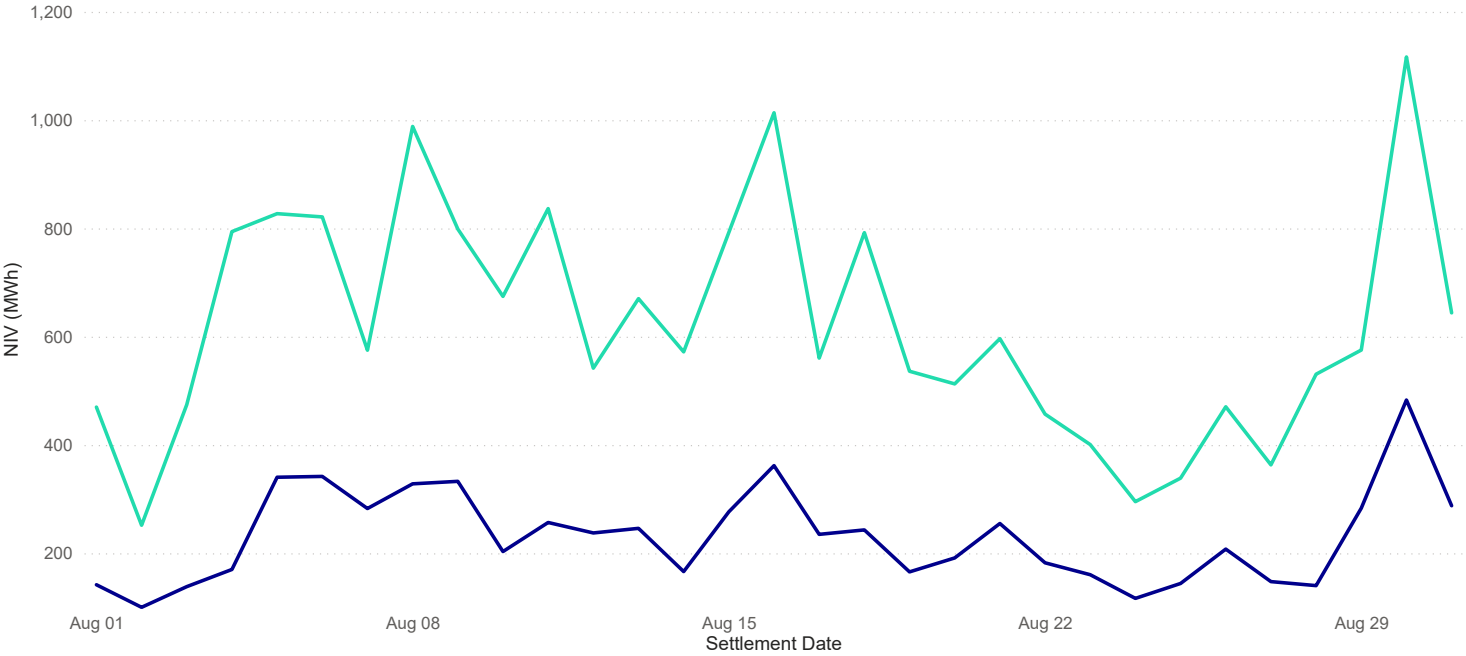

Microsoft Power BI




Long system NIV

This graph shows the minimum and average NIVs when the system was long. Note short NIVs are depicted as positive volumes and long NIVs are depicted as negative volumes.



2.7 Long System NIV

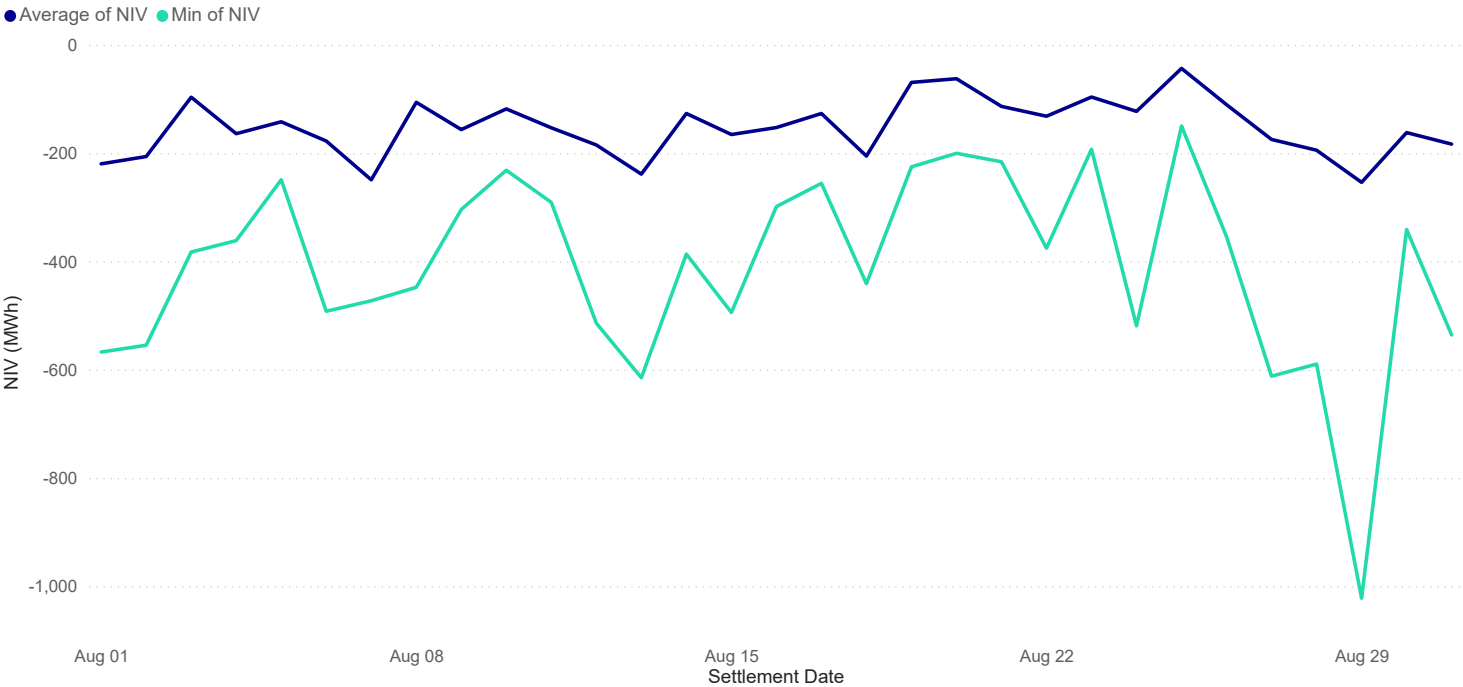

Microsoft Power BI



In almost all Settlement Periods, the System Operator will need to take balancing actions in both directions (Buys and Sells) to balance the system. However, for the purposes of calculating an Imbalance Price there can only be imbalance in one direction (the Net Imbalance). ‘NIV Tagging’ is the process which subtracts the smaller stack of balancing actions from the larger one to determine the Net Imbalance. The price is then derived from these remaining actions.

NIV Tagging has a significant impact in determining which actions feed through to prices. In August, 85% of volume was removed due to NIV tagging. The most expensive actions are NIV Tagged first; hence NIV Tagging has a dampening effect on prices when there are balancing actions in both directions.

The maximum short system NIV of the month (1,117MWh) was seen in Settlement Period 26 on 30 August, where the System Price was £158.00/MWh.

The minimum long system NIV of the month was -1,022MWh, in Settlement Period 44 on 29 August, where the System Price was £62.55/MWh.


Net Imbalance Volume and System Price

This graph displays a scatter graph of Net Imbalance Volume and System Prices. The dashed lines display a 0MWh NIV and a £0.00/MWh System Price, the red line is a trendline with the expected System Price from a particular NIV based on the month's data.



2.8 Net Imbalance Volume and System Price

System Length ● Long ● Short

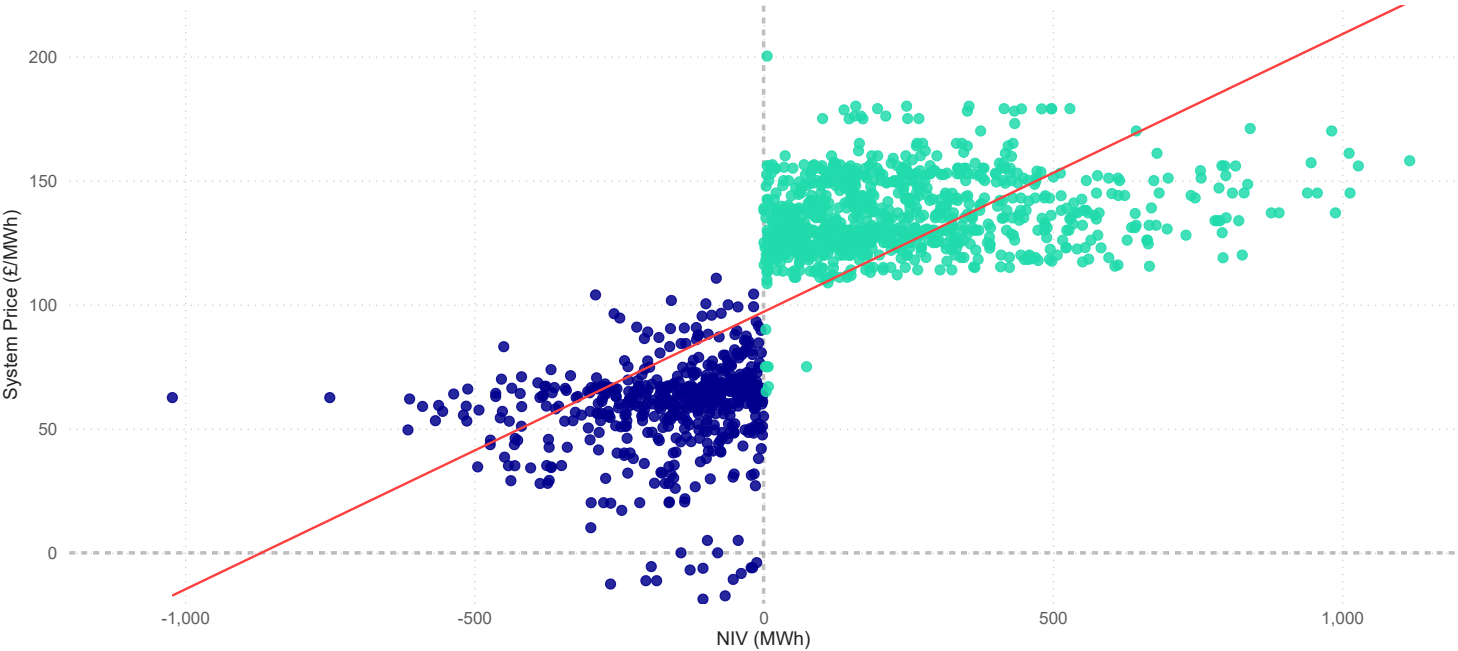

Microsoft Power BI



There were 541 long Settlement Periods in August, 36 of which occurred on 2 August. The average NIV on this day was -130MWh, with the lowest NIV (-555MWh) occurring in Settlement Period 17. The highest System Price of the month £200.18/MWh had a short NIV of 6MWh, the seventeenth lowest short NIV of the month.

PAR Tagging

PAR Tagging is the final step of the Imbalance Price calculation. It takes a volume-weighted average of the most expensive 1MWh of actions left in the stack. The value of PAR is set at 1MWh.

PAR Tagging is active in almost all Settlement Periods, the only periods not affected by the parameter have a NIV of less than 1MWh.

During August, there were 5 Settlement Periods where PAR Tagging was inactive. The average NIV in these Settlement Periods was 0.48MWh. Settlement Period 34 on 23 August had the lowest absolute NIV (-0.1MWh), and therefore was the most balanced Settlement Period of the month.


DMAT and Arbitrage Tagged Volumes

Some actions are always removed from the price calculation (before NIV Tagging). These are actions which are less than the De Minimis Acceptance Threshold (DMAT) Tagging or Buy actions which are either the same price or lower than the price of Sell actions (Arbitrage Tagging). The DMAT is set at 0.1MWh.

**Daily Volume of DMAT Tagged volume** This graph shows the volumes of actions removed due to DMAT Tagging.



2.9 Daily DMAT Tagged volume

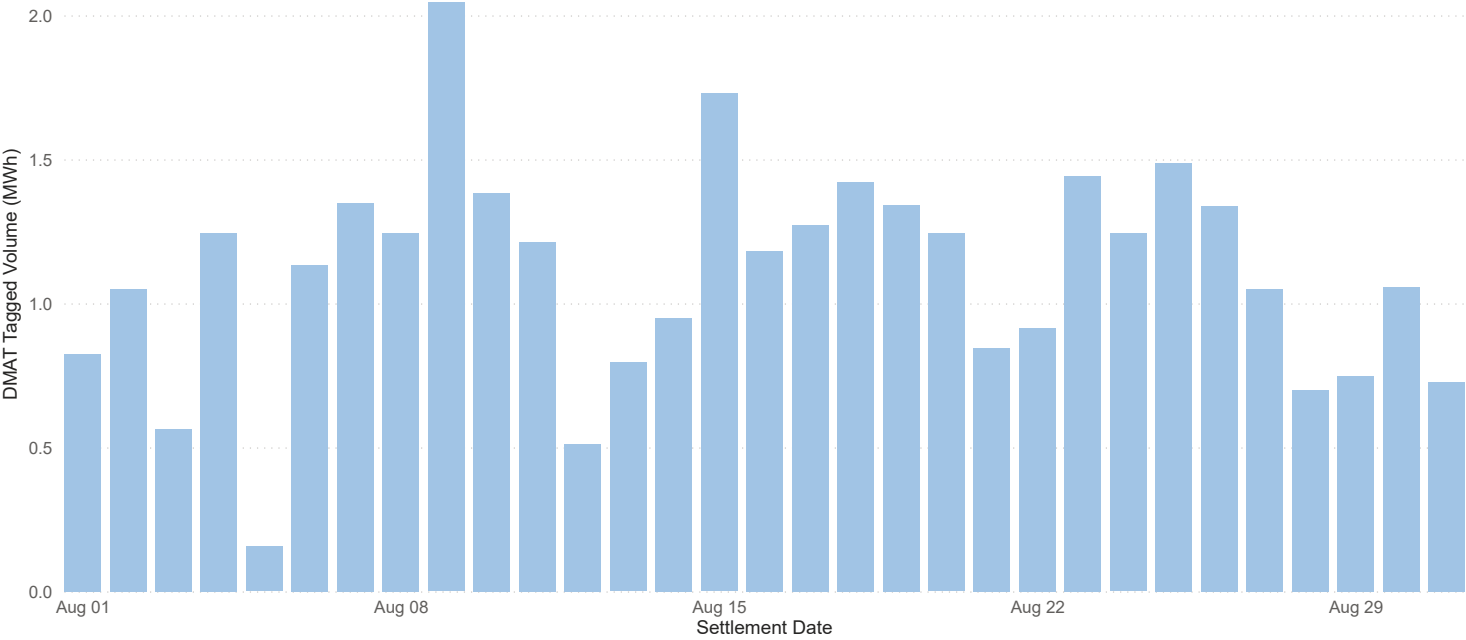

Microsoft Power BI




34.2MWh of total Buy and Sell volume was removed by DMAT Tagging in August, compared to 31.2MWh the previous month. 47% of the DMAT Tagged volume came from CCGT BMUs, 33% from other BMUs and 10% from Gas BMUs.


Daily volume of Arbitrage Tagged volume

This graph shows the volumes of actions that were removed due to Arbitrage Tagging.

## 2.10 Daily Arbitrage Tagged volume

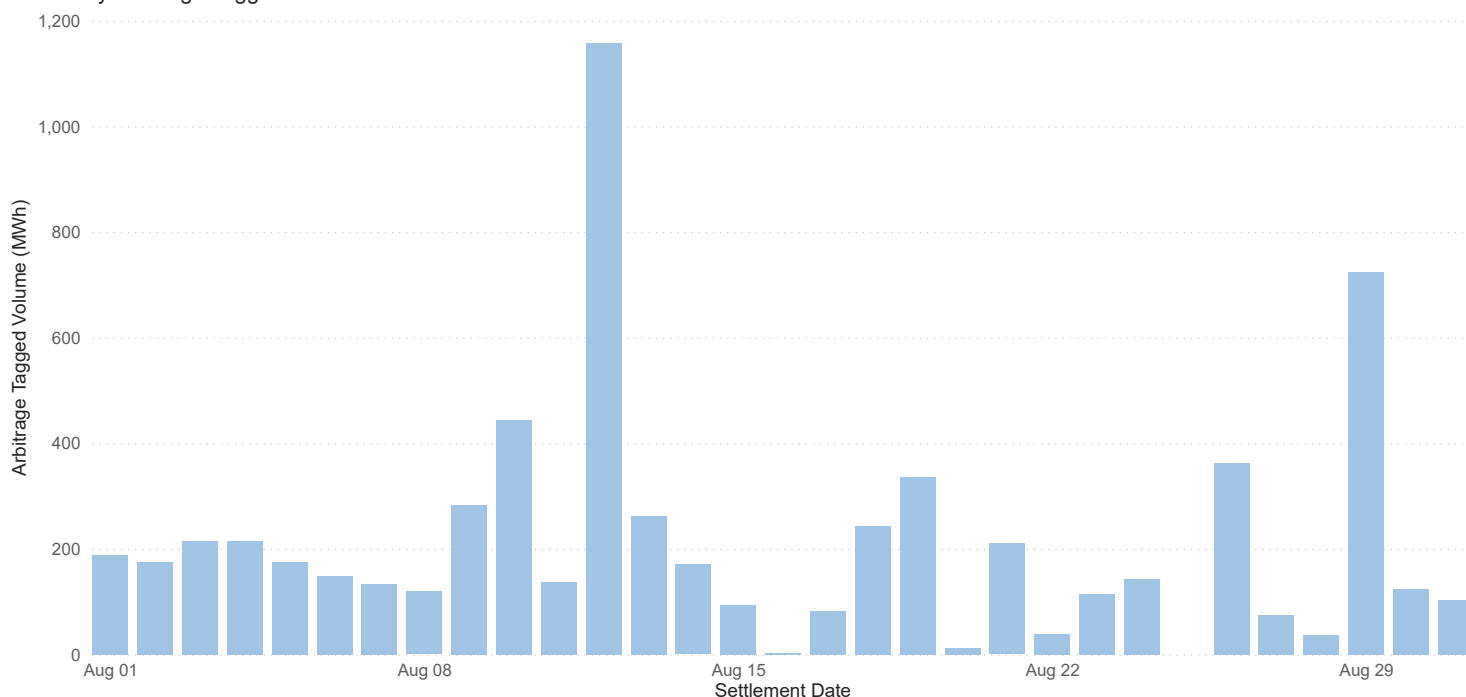

Microsoft Power BI



6522MWh of total Buy and Sell volume was removed by Arbitrage Tagging in August. 50% of the Arbitrage Tagged came from CCGT BMUs, 33% from BSAAs and 7% from other BMUs.

In August, the average initial price of an Arbitrage Tagged Buy action was £82.48/MWh, and for a Sell action was £88.19/MWh. The maximum initial price of an Arbitrage Tagged Sell action was £170.00/MWh, and the lowest priced Arbitrage Tagged Buy action was -£16.00/MWh.

On 12 August, 1,158MWh of actions were Arbitrage Tagged, representing 1.5% of the daily volume of balancing actions. The average price of an Arbitrage Tagged Buy action was £52.92/MWh, and for a Sell action was £101.82/MWh on this day. 50% of the Arbitrage Tagged Volume came from BSAAs, 32% from CCGT BMUs and 18% from Wind BMUs.

## 3 Balancing Services

### Short Term Operating Reserve (STOR) costs and volumes

This section covers the balancing services that the System Operator (SO) takes outside the Balancing Mechanism that can affect the price.

In addition to Bids and Offers available in the Balancing Mechanism, the SO can enter into contracts with providers of balancing capacity to deliver when called upon. These additional sources of power are referred to as reserve, and most of the reserve that the SO procures is called Short Term Operating Reserve (STOR).


Under STOR contracts, availability payments are made to the balancing service provider in return for capacity being made available to the SO during specific times (STOR Availability Windows). When STOR is called upon, the SO pays for it at a pre-agreed price (its Utilisation Price). Some STOR is dispatched in the Balancing Mechanism (BM STOR) while some is dispatched separately (Non-BM STOR).

#### Daily STOR vs Non-BM STOR volume

This graph gives STOR volumes that were called upon during the month split into BM STOR and non-BM STOR. 23% of the total STOR volume utilised in August came from outside of the Balancing Mechanism.



3.1 Daily STOR BM vs Non BM volumes

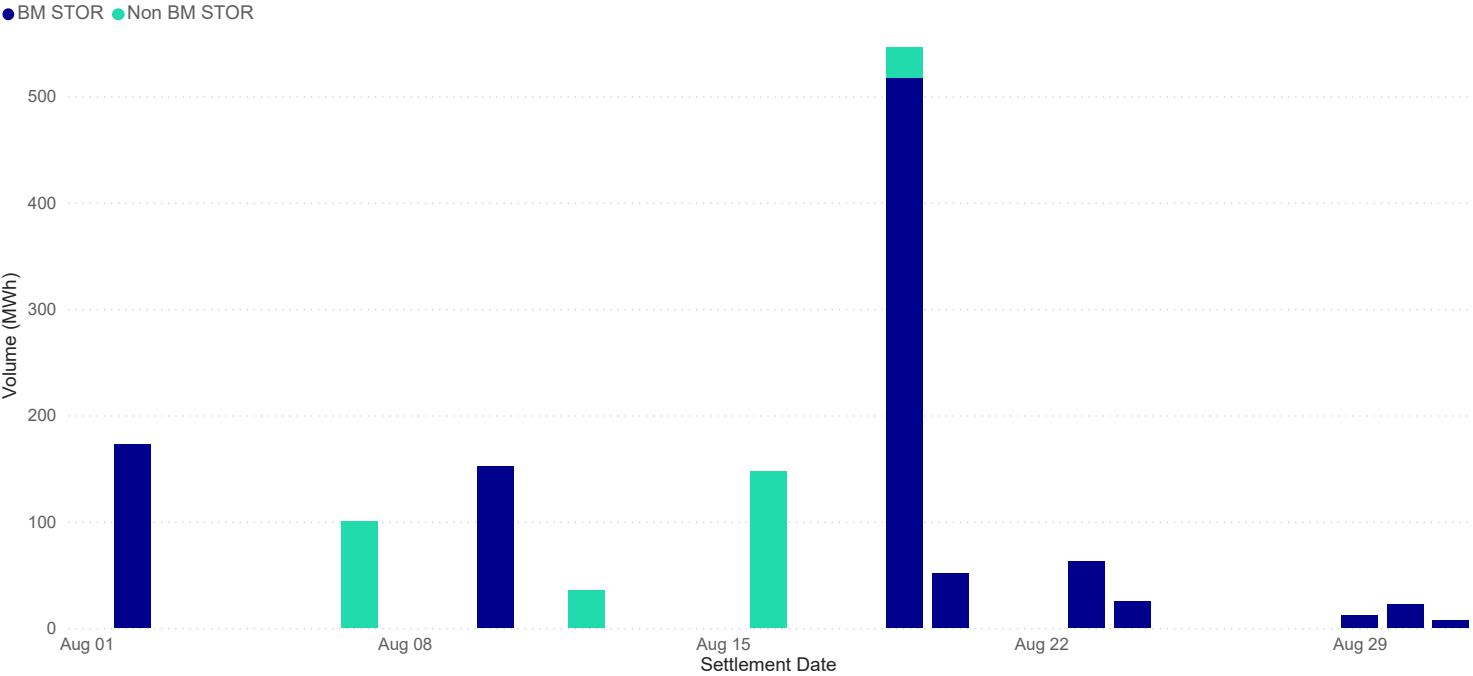


Daily STOR vs Non-BM STOR utilisation costs

This graph shows the utilisation costs of this capacity. The average Utilisation Price for STOR capacity in August was £189.17/MWh; £207.42/MWh for BM STOR and £129.06/MWh for non-BM STOR.



3.2 Daily STOR BM vs Non BM utilisation costs

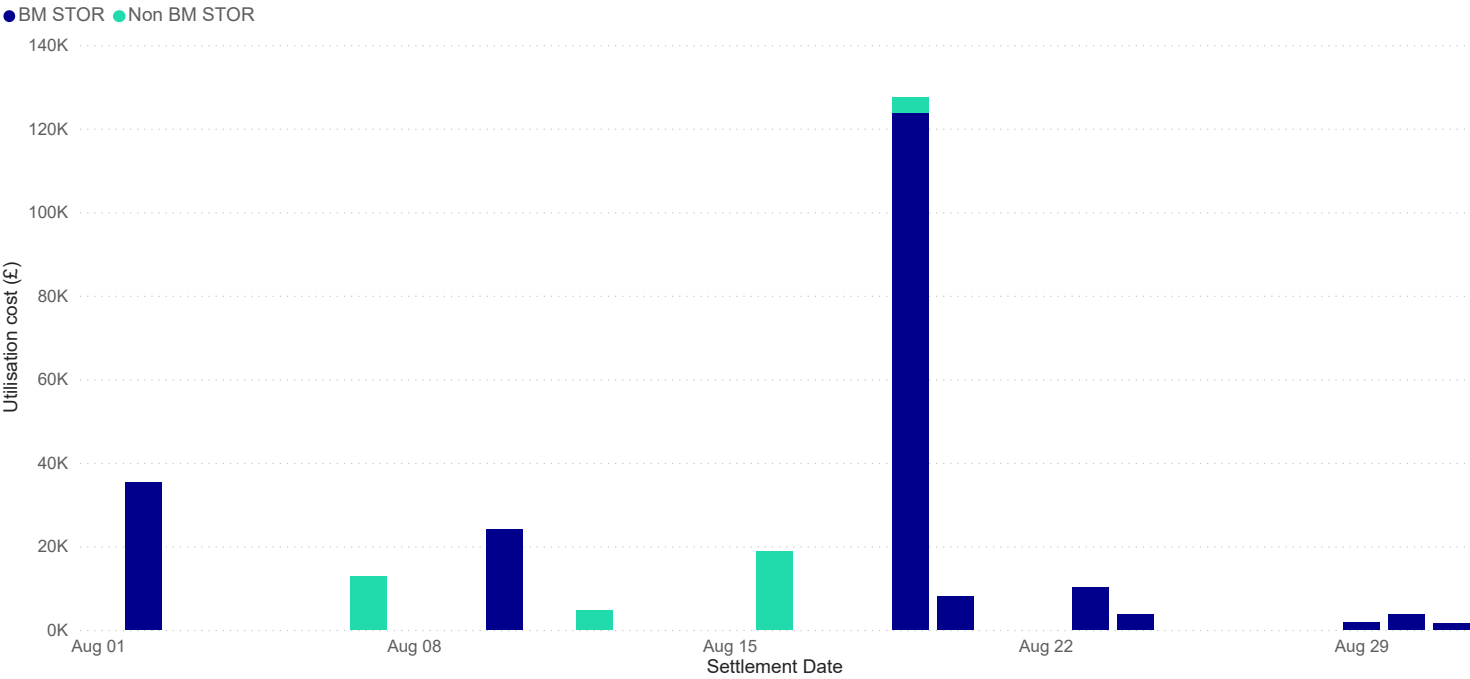

Microsoft Power BI



On 19 August the largest amount was spent on STOR volume for the month (£127,437), of which 97% of the cost was BM STOR and 3% was non-BM STOR. The utilised BM STOR volume on this day was 518MWh, compared to the average of 33MWh across the month.

De-Rated Margin, Loss of Load Probability and the Reserve Scarcity Price

There are times when the Utilisation Prices of STOR plants are uplifted using the **Reserve Scarcity Price (RSVP)** in order to calculate System Prices. The RSVP is designed to respond to capacity margins, so rises as the system gets tighter (the gap between available and required generation narrows). It is a function of **De-Rated Margin (DRM)** at Gate Closure, the likelihood that this will be insufficient to meet demand (the **Loss of Load Probability, LoLP**) and the **Value of Lost Load (VoLL)**, set at £6,000/MWh from 1 November 2018).

**Minimum and average DRMs** This graph shows the daily minimum and average Gate Closure DRMs for August 2021.




3.3 Minimum and average DRMs

● Average of DRM ● Min of DRM



Microsoft Power BI



The System Operator has determined a dynamic relationship between each DRM and the LoLP, which will determine the RSVP.

The minimum DRM in August was 1.754GW on 19 August in Settlement Period 36 (compared to 1.967GW in July). This DRM corresponded to a LoLP of 0.0034 and a RSVP of £20.46/MWh (see **Top 5 LoLPs and RSVPs**).

The RSVP re-prices STOR actions in the Imbalance Price calculation if it is higher than the original Utilisation Price. No actions were repriced with the RSVP during August.

Top 5 LoLPs and RSVPs

Settlement Date	Settlement Period	DRM (MW)	LoLP	RSVP (£/MWh)	RSVP Used	System Price (£/MWh)	System Length
19/08/2021	36	1,754	0.0034	20.46	No	46.00	Long
19/08/2021	37	1,881	0.0022	12.91	No	200.18	Short
19/08/2021	38	2,008	0.0012	7.43	No	160.00	Short
19/08/2021	35	2,221	0.0004	2.33	No	60.00	Long
19/08/2021	39	2,488	0.0001	0.81	No	174.89	Short

Source: Elexon