



Bourne House
475 Godstone Road, Whyteleafe

Surrey, CR3 0BL

C&C Group Holdings Ltd, Registered No: 5106541

www.candc-uk.com

Technical Assurance Agent Annual Report: BSC Year 2018/19

Non-Confidential

Document Control

Distribution	Reviewers
C&C Group	Paul Gregory Lisa Young Stuart Jackson Neil McKeown
ELEXON	Katherine Higby Beth Proctor Christopher Day Thomas Walklate

Owner / Issuing Authority	Approved by	Date
C&C Group	Neil McKeown	17/05/2019

Change History

Version	Date	Author	Reason for new version	Sections Affected
0.1	18/04/2019	Lisa Young	Initial Draft	All
0.2	23/04/2019	Lisa Young	Updated following initial ELEXON review	All
0.5	24/04/2019	Lisa Young	Client review	All
0.6	03/05/2019	Lisa Young	Update following ELEXON review	All
0.7	14/05/2019	Lisa Young	Update following ELEXON review	All
1.0	17/05/2019	Lisa Young	Final	All

Document name and location	TAA Non-Confidential TAA Annual Report 2018-2019 V1 Final.doc
----------------------------	---

References

No	Title
1	TAA Agreement

Security and Confidentiality

This document remains the property of C&C Group at all times, and must not be circulated to third parties without the express permission of C&C Group.

Indemnity

C&C Group do not accept any responsibility for any consequences as a result of any errors or omissions in this document, and confirm that nothing in the document constitutes a contractual or commercial statement unless this document is specifically referred to in a contract.

Contents

1	Glossary of terms and acronyms	6
2	Introduction.....	7
2.1	The purpose of the Technical Assurance Agent (TAA) Annual Report	7
2.2	The Scope of the 2018/19 audit	7
3	Executive Summary	8
3.1	Category 1 non-compliances	8
3.1.1	SVA Category 1 non-compliances.....	8
3.1.2	CVA Category 1 non-compliances.....	8
3.1.3	SVA Category 2 non-compliances.....	8
3.1.4	CVA Category 2 non-compliances.....	9
4	Statement on the health of the Metering System population	10
4.1	The SVA market	10
4.1.1	Good news.....	10
4.1.2	Bad news.....	10
4.2	The CVA market.....	10
4.2.1	Good news.....	10
4.2.2	Bad News	10
4.3	Category 1 Non-Compliances	11
4.3.1	The SVA Market	11
4.3.2	The CVA Market.....	11
4.4	Category 2 Non-Compliances	12
4.4.1	The SVA Market	12
4.4.2	The CVA Market.....	12
4.5	Materiality	13
5	Key Issues.....	14
5.1	Measurement transformer ratio mismatches.....	14
5.1.1	The Issue	14
5.1.2	Commissioning	14
5.1.3	Our recommendations	14
5.2	Measurement transformer Calibration Certificates.....	14
5.2.1	The issue	14
5.2.2	Our recommendations	15
6	Audit Planning Performance.....	16
6.1	Planned Inspection Visits vs cancellations	16
6.2	No Access performance.....	16
6.2.1	SVA.....	16
6.2.2	CVA	16

6.2.3	No access performance comparison	16
6.2.4	Reasons for No Access:.....	17
6.3	LDSO attendance at Inspection Visits.....	17
7	Appendix 1 – 2018/19 Audit Findings	18
7.1	Introduction.....	18
7.1.1	Important notes and assumptions	18
7.2	SVA audits (Main/Re-inspection).....	18
7.2.1	Appointment statistics summary.....	18
7.2.2	CDCC performance	20
7.2.3	SVA non-compliances identified during the 2018/19 audit year	21
7.2.4	Potential Settlement impacting materiality calculations for Category 1 non-compliances identified.	23
7.2.5	Rectification of Category 1 non-compliances.....	24
7.2.6	Category 2 non-compliances	25
7.3	CVA Audits	29
7.3.1	Appointments planned and cancelled.....	29
7.3.2	CDCC Performance	29
7.3.3	CVA non-compliances identified during 2018/19 audit year	30
7.3.4	Potential Settlement impacting non-compliance calculations.....	31
8	Appendix 2 – Category 1 and 2 non-compliance descriptions	32

1 Glossary of terms and acronyms

Term/Acronym	Definition
100kW Metering System	As defined in Section X, Annex X-1. Section L2.2 requires the Metering Equipment for a 100kW Metering System to be Half Hourly Metering Equipment.
BMU	Balancing Mechanism Unit
BSC	Balancing and Settlement Code
BSCP	Balancing and Settlement Code Procedure
Category 1 non-compliance	A non-compliance that is deemed to be currently affecting the quality of data for Settlement purposes
Category 2 non-compliance	A non-compliance that is deemed to have the potential to affect the quality of data for Settlement purposes
CDCA	Central Data Collection Agent
CDCC	Consumption Data Comparison Check
Commissioning	A process to ensure that the energy flowing across a Defined Metering Point is accurately recorded by the associated Metering System
CoP	Code of Practice
CT	Current Transformer
CVA	Central Volume Allocation
DC	Data Collector
DMP	Defined Metering Point
ECOES	Electricity Central Online Enquiry Service
EFR	Error and Failure Resolution
HV	High Voltage
LDSO	Licensed Distribution System Operator
LV	Low Voltage
MAR	Meter Advance Reconciliation
MC	Measurement Class
MC 'C'	Measurement Class C – Half Hourly metered at 100kW premises
MC 'E'	Measurement Class E – Half Hourly metered at below 100kW premises with current transformer
MCI	Multi Circuit Inspection
ME	Metering Equipment
MOA	Meter Operator Agent
MRM	Meter Register Multiplier
MSID	Metering System Identifier
MTD	Meter Technical Details
NC non-compliance	Consumption data held by Data Collector outside tolerance when compared with metered energy data
NMTES	National Measurement Transformer Error Statement
Observation	A non-compliance that is deemed neither to affect nor have the potential to affect the quality of data for Settlement purposes
OSWF	Offshore Wind Farm
PAB	Performance Assurance Board
SAP	Senior Authorised Person
SVA	Supplier Volume Allocation
TAA	Technical Assurance Agent
TAAMT	TAA Management Tool
TAM	Technical Assurance of Metering
TAMEG	Technical Assurance of Metering Expert Group
TAPAP	Technical Assurance of Performance Assurance Parties
UTC	Co-ordinated Universal Time
VT	Voltage Transformer

2 Introduction

2.1 The purpose of the Technical Assurance Agent (TAA) Annual Report

The Technical Assurance of Metering (TAM) technique monitors compliance of 100kW Metering Systems registered and energised in Settlement, as documented in the Balancing and Settlement Code (BSC) and its Code Subsidiary Documents (CSDs).

The TAA Annual Report provides our opinion as the TAA on the health of the 100KW Metering System population. The report contains findings from the TAA audit undertaken during the 2018/19 audit year (and trends over the previous three audit years).

The TAA has interpreted the data detailed in Appendix 1 – 2018/19 Audit Statistics and the following provides a summary of that interpretation in the following sections 3-6

2.2 The Scope of the 2018/19 audit

During the 2018/19 audit year, the TAA audited 1,610 Metering Systems:

- Supplier Volume Allocation (SVA) Half Hourly (HH) Metering Systems:
 - **Total Inspection Visits - 1,541¹**
 - Main Sample² – 1,537
 - Re-inspection - 4
 - Specific Sample³ – 0
 - Targeted⁴ – 0
- Central Volume Allocation (CVA) Metering Systems:
 - **Total Inspection Visits - 69⁵**
 - Main Sample – 64
 - Offshore wind farms – 4
 - Re-inspection - 1
 - Targeted – 4

Offshore wind farms and multi circuit CVA Inspection Visits were included in the audit scope for the first time in 2018/19.

¹ 1% of the SVA Metering System population

² A representative sample of Metering Systems.

³ Focuses on an area of perceived risk to Settlement - SVA only.

⁴ Where non-compliance is suspected.

⁵ 5% of the CVA Metering System population.

3 Executive Summary

3.1 Category 1 non-compliances⁶

3.1.1 SVA Category 1 non-compliances

The 2018/19 audit has identified the following number of SVA Category 1 non-compliances.

Category ⁷	1.01	1.02	1.03	1.04	1.06
Number of Category 1 NCs	1	9	4	7	0
% of SVA Category 1 NCs identified	4.8%	42.9%	19.0%	33.3%	0.0%
% of total SVA Inspection Visits undertaken	0.1%	0.7%	0.3%	0.5%	0.0%

3.1.2 CVA Category 1 non-compliances

The 2018/19 audit has identified the following number of CVA Category 1 non-compliances.

Category	1.01	1.02	1.03	1.04	1.06
Number of Category 1 NCs	0	1	2	0	2
% of CVA Category 1 NCs identified	0.0%	20.0%	40.0%	0.0%	40.0%
% of total CVA circuit inspections undertaken	0.0%	0.5%	1.0%	0.0%	1.0%

3.1.3 SVA Category 2 non-compliances

The 2018/19 audit has identified the following number of SVA Category 2 non-compliances.

3.1.3.1 Non-certificate related SVA Category 2 non-compliances:

Category	2.01	2.02	2.03	2.09	2.10	2.11	2.13	2.14
Number of Category 2 NCs	35	18	20	11	27	40	286	44
% of SVA Category 2 NCs identified	1.1%	0.6%	0.7%	0.4%	0.9%	1.3%	9.3%	1.4%
% of total SVA Inspection Visits undertaken	2.7%	1.4%	1.5%	0.8%	2.0%	3.0%	22.0%	3.4%

3.1.3.2 Certificate related SVA Category 2 non-compliances:

Category	2.06	2.15	2.15L	2.15M	2.16	2.17
Number of Category 2 NCs	534	777	76	94	675	433
% of SVA Category 2 NCs identified	17.4%	25.3%	2.5%	3.0%	22.0%	14.1%
% of total SVA Inspection Visits undertaken	41.0%	59.7%	5.8%	7.2%	51.8%	33.3%

⁶ A non-compliance against the BSC or CSD, which is deemed to be currently affecting the quality of data for Settlement purposes.

⁷ See Appendix 2 for descriptions of all categories of non-compliance.

3.1.4 CVA Category 2 non-compliances

The 2018/19 audit has identified the following number of CVA Category 2 non-compliances

Category	2.01	2.02	2.03	2.06	2.10	2.11	2.13	2.15	2.16	2.17
Number of Category 2 NCs	1	14	33	84	10	2	82	113	155	53
% of SVA Category 2 NCs identified	0.18%	2.6%	6.0%	15.4%	1.8%	0.4%	15.0%	20.7%	28.3%	9.7%
% of total CVA circuit inspections undertaken	0.5%	6.7%	15.6%	39.8%	4.7%	0.9%	38.9%	53.6%	73.4%	25.1%

4 Statement on the health of the Metering System population

This section gives our opinion on the health of the SVA and CVA markets based on the 2018/19 audit year findings. The TAA has formulated its opinion by looking at trends in non-compliances reported over the previous years and through discussions with key Market Participants whilst undertaking TAA activities.

4.1 The SVA market

4.1.1 Good news

The TAA is pleased to report a reduction by approximately 35% in the number of Category 1 non-compliances identified in comparison to 2017/18. The TAA recorded **21** Category 1 non-compliances in 2018/19 in comparison to **32** recorded in 2017/18. This decrease is because of a reduction of Category 1.03⁸ non-compliances. A breakdown of Category 1 non-compliances is available in Table 6 of Appendix 1

The TAA has reported a 50% reduction in the number of Category 2.02⁹ non-compliances. This could indicate an improvement in back-office documentation management, also supported by the SVA Category 2 non-compliance reporting. A breakdown of Category 2.02 non-compliances is available in Table 10 of Appendix 1.

4.1.2 Bad news

The TAA has identified a significant increase in the number of Category 1.04¹⁰ non-compliances. These non-compliances have been assigned to Metering Systems commissioned prior to the implementation of BSC Modification P283¹¹.

The TAA has concerns with the time taken for parties to rectify Category 1 non-compliances. Category 1 non-compliances took approximately 30 days to resolve on average.

At the time of preparing our report, eight Category 1 non-compliances that were identified this year have not been rectified. Details of rectification timescales are available in Table 9 of Appendix 1.

4.2 The CVA market

4.2.1 Good news

In 2018/19, the TAA successfully audited four offshore wind farms. The TAA is pleased to report that it did not identify any Category 1 non-compliances during these checks. In addition, 100% access was achieved.

The TAA can also confirm that all other Category 1 non-compliances reported have now been resolved.

4.2.2 Bad News

Of the 211 Circuits accessed, the TAA reported 113 non-compliances relating to missing, incomplete or incorrect Commissioning records. Of the 113 non-compliances, 80% were raised because Commissioning records were not provided. The remainder of these non-compliances related to Commissioning records being either incomplete or incorrect.

⁸ major time drift

⁹ non-compliances relating to inaccurate Standing Data held by the Half Hourly Data Collector (HHDC)

¹⁰ current transformer (CT) ratio mismatches


¹¹ Reinforcing the Commissioning of Metering Equipment processes

4.3 Category 1 Non-Compliances

4.3.1 The SVA Market

The number of Category 1.03¹² non-compliances has decreased; however, a significant increase in Category 1.04¹³ non-compliances was recorded. The TAA has also recorded an increase in Metering Equipment non-compliances.

Figure 2 – SVA Category 1 non-compliances identified in the previous three audit years

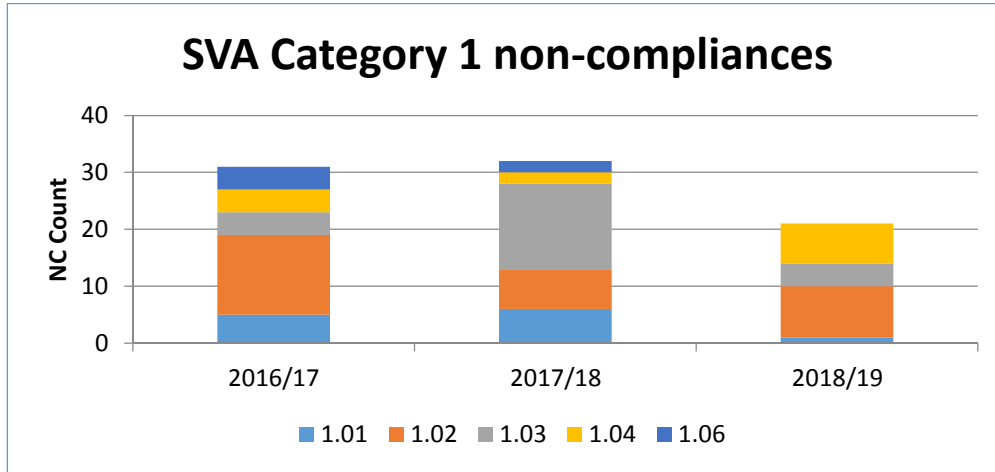


4.3.2 The CVA Market

There has been an increase in the number of Category 1 non-compliances in the CVA market in this audit period.

The TAA detected four Category 1 non-compliances attributed to one multi-circuit Inspection Visit with four circuits. A further non-compliance was reported against a targeted Inspection Visit.

Figure 3 – CVA Category 1 non-compliances identified in the previous three audit years

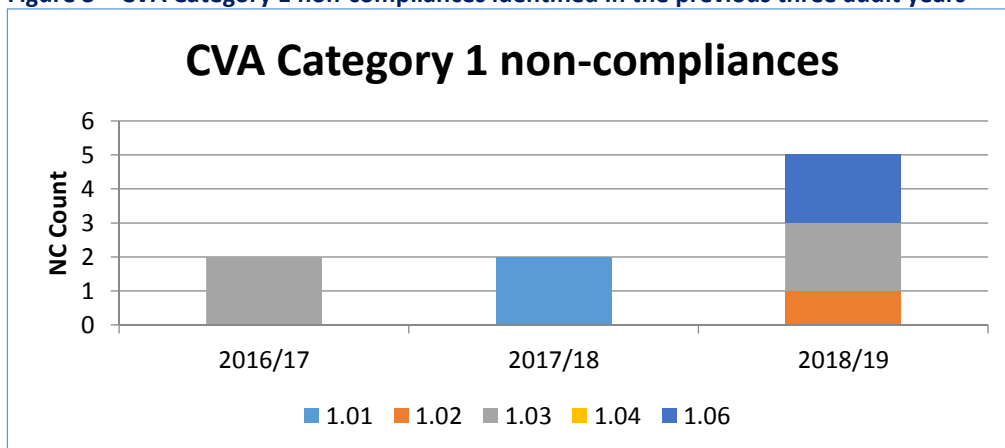

¹² Major time drift

¹³ measurement transformer ratio physically incorrect


4.4 Category 2 Non-Compliances

4.4.1 The SVA Market

The TAA has noticed a general increase in Calibration Certificate related non-compliances across all sub categories of reporting. However, The TAA is pleased to see a reduction in non-certificate related non-compliances showing an improvement in back office documentation management.

Figure 4 below shows the number of Category 2 non-compliances identified over the past three audit years split by Calibration Certificate/Commissioning related and other non-compliances.


Figure 4 - SVA Category 2 non-compliances identified

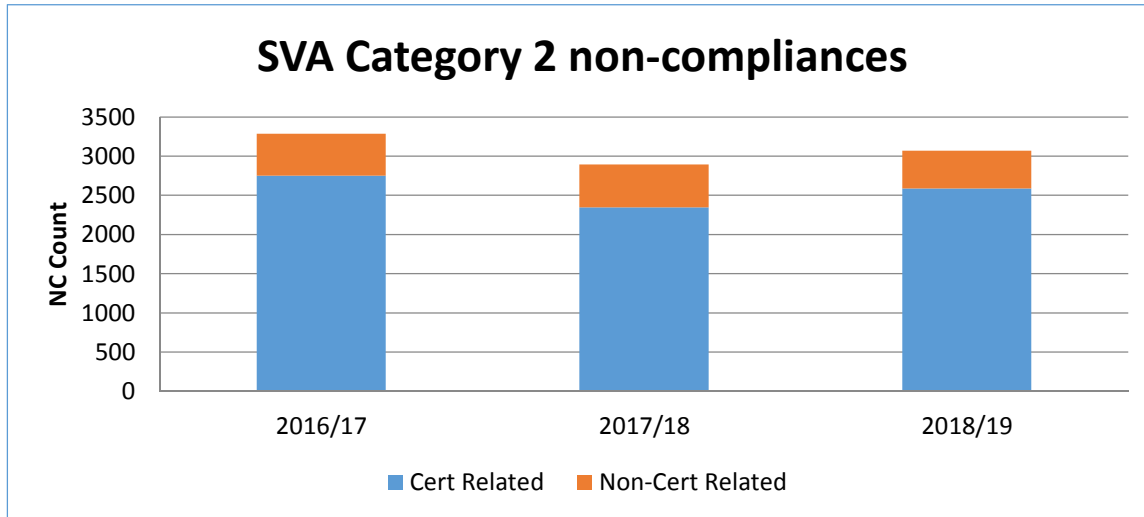

4.4.2 The CVA Market

An initial review of the comparison between this year's reporting and that of 2017/18 indicates a continued upward trend, however once the increased number of Inspection Visits due to the introduction of multi-circuit Inspection Visits is factored in, actual non-compliance rates have fallen.

Figure 5 – CVA Category 2 non-compliances identified

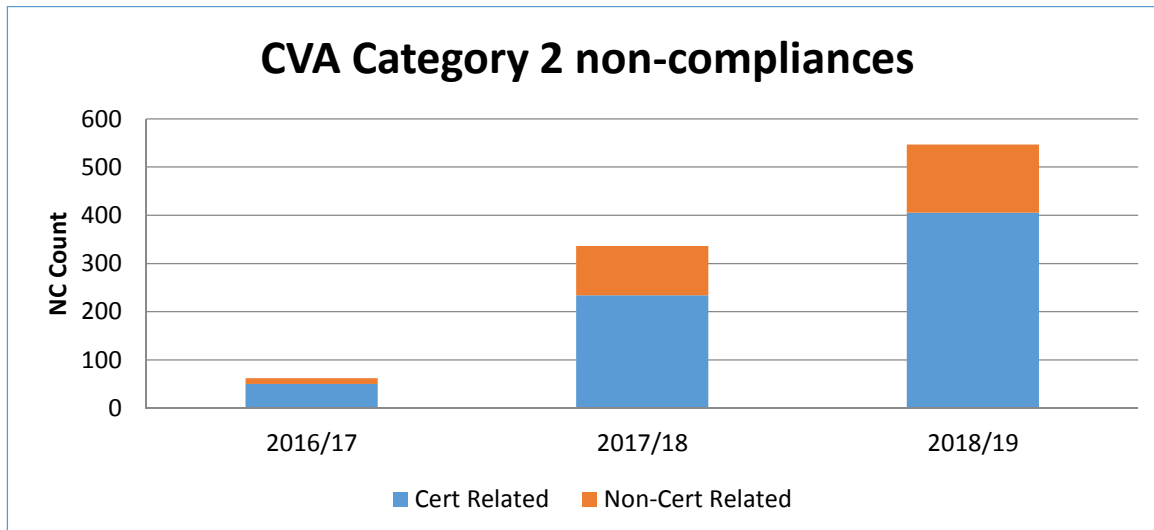

4.5 Materiality

ELEXON identified the material impact on Settlement of the identified Category 1 non-compliances as:

CVA

£0 Materiality

There were five Category 1 non-compliances. Four had no impact on Settlement, and one is an on-going Trading Dispute of which the materiality has not yet been determined.

SVA

£245,142.24 Materiality

Two SVA Category 1 non-compliances had a material impact on Settlement.

Both were Category 1.04 non-compliances, raised because the measurement transformer ratios were different from those set up in the Meter.

5 Key Issues

The TAA would like to draw attention to the following key issues identified in 2018/19:

5.1 Measurement transformer ratio mismatches

5.1.1 The Issue

The TAA has seen an increase in Category 1.04¹⁴ non-compliances recorded in 2018/19. These non-compliances were linked to measurement transformer ratio mismatches between the ratio programmed into the Meter and the actual ratios of the CTs as witnessed by the auditor. Of all Category 1 non-compliances recorded, 33% were attributed to Category 1.04 failures.

The reporting figures for 2018/19 indicate an increase in the Commissioning of SVA Metering Systems. This figure includes all Commissioning non-compliances for pre P283 at 60%, post P283 for Meter Operator Agent (MOA) at 7% and Licensed Distribution System Operator (LDSO) at 6%.

As per previous Annual Reports, the majority of Metering Systems where Category 1 non-compliances have been raised the TAA also recorded Commissioning related non-compliances.

5.1.2 Commissioning

The 2018/19 audit scope saw the introduction of a new audit process that enabled the TAA to allocate Commissioning related non-compliances to the most appropriate Party for rectification. This process included the introduction of Category 2 non-compliance types 2.15L and 2.15M. The non-compliances are allocated to the LDSO and the MOA respectively.

Table A – HHMS audited that were commissioned post P283 with associated commissioning non-compliances

Number of Completed Inspection Visits	2.15L	% of Inspections	2.15M	% of Inspections
157	76	48%	94	60.0%

Table B – HHMS audited that were commissioned pre P283 with associated Commissioning non-compliances

Number of Completed Inspection Visits	2.15	%age of Inspections
1,145	777	68%

5.1.3 Our recommendations

The TAA recommends that ELEXON issues guidance or training to assist parties in understanding the importance of Commissioning in accordance with Code of Practice (CoP) 4¹⁵.

5.2 Measurement transformer Calibration Certificates

5.2.1 The issue

In 2018/19, the TAA continues to report the lack of measurement transformer Calibration Certificates as a key issue.

¹⁴ Measurement Transformer Ratios Physically Incorrect

¹⁵ Code of Practice 4 'The Calibration, testing and commissioning Requirements of Metering Equipment for Settlement Purposes'

Each CoP requires Calibration Certificates be made available to the TAA for review at a TAA Inspection Visit. The number of non-compliances recorded would indicate that certificates are no longer readily available to present to the TAA auditor, possibly due to the age of many 100kW Metering System installations.

In 2018/19 the TAA has recorded 675 non-compliances which will be added to the escalating number of outstanding measurement transformer certificate non-compliances, which now runs into thousands.

5.2.2 Our recommendations

The TAA recommends a concerted effort by all industry participants to establish what is now deemed as satisfactory evidence in maintaining Metering System overall accuracy in order to reduce the number of new non-compliances being raised.

The TAA also recommends that the historic non-compliances are cleared in a way that is acceptable to ELEXON and the PAB.

6 Audit Planning Performance

6.1 Planned Inspection Visits vs cancellations

In total, the TAA planned 1,648 SVA Inspection Visits during this 2018/19, of which 107 were cancelled at the request of Market Participants due to a range of issues. This equates to 6.5% of those Inspection Visits planned in the SVA market.

The cancellation rate for CVA Inspection Visits increased from 5% last year to 8% this year.¹⁶

6.2 No Access performance

6.2.1 SVA

The No Access rate for SVA Inspection Visits has increased this year to 16% compared to the last two audit years where No Access was approximately 10%.

No Access this year was attributed to a mixture of customer availability, lost keys and empty buildings.

A detailed breakdown of No Access by Supplier Company Group is available in table 2 of appendix 1.


6.2.2 CVA

The TAA was unable to gain access to 8% of circuits.

6.2.3 No access performance comparison

The following graph shows a comparison of No Access performance of the last three audit years:

Figure 6 – No Access performance for previous three audit periods

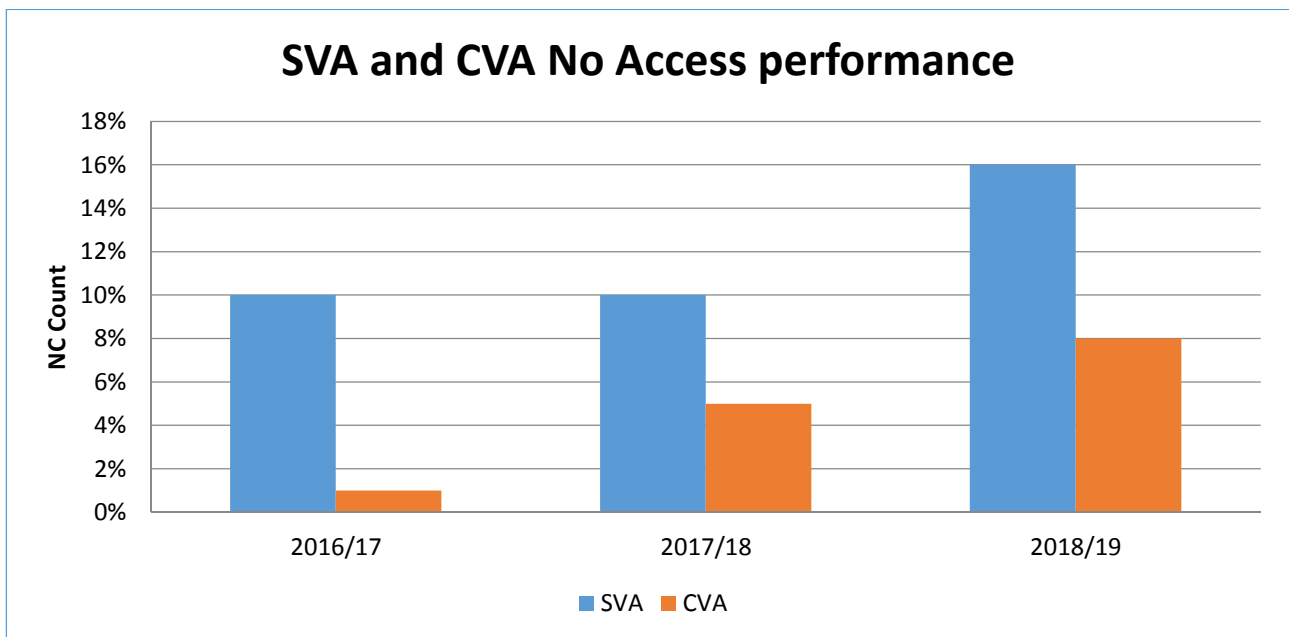

¹⁶ This increase can be accounted for by the Multi Circuit Inspections.

6.2.4 Reasons for No Access:

6.2.4.1 SVA

Table C – The most common reasons for SVA No Access

Appointment Status	Count	% of No Access
No Access - Site visited customer unavailable to provide access	114	48.7%
No Access - Site visited customer unable to provide access	31	14.2%
No Access - Customer unable to find keys	27	11.9%

6.2.4.2 CVA

Table D – The most common reasons for CVA No Access

Appointment Status	Count	% of No Access
No Access - Other Reason (onsite)	10	55.6%
No Access - LSDO and/or SAP attendance required to access Metering Equipment.	6	33.3%
No Access - MOP Representative did not attend	2	11.1%

6.3 LDSO attendance at Inspection Visits

BSCP27 obligates the Registrant to ensure that the LDSO attends Inspection Visits for HV Metering Systems and Metering Systems where Metering Equipment includes LV remote CTs. Our high-level analysis continues to suggest that Registrants are not meeting this obligation in many cases.

A breakdown of performance for each Supplier Company Group is available in Table 3 of Appendix 1.

7 Appendix 1 – 2018/19 Audit Findings

7.1 Introduction

This appendix details the results of our TAA audit findings for the 2018/19 TAA audit year, which are referred to throughout this report.

7.1.1 Important notes and assumptions

Percentage totals identified in this document may not equal exactly 100% if summed, due to rounding. Some non-compliances are categorised as miscellaneous categories because the issues are too disparate to group and report on effectively.

7.2 SVA audits (Main/Re-inspection)

7.2.1 Appointment statistics summary

Table 1: Total number of SVA Inspection Visits planned and outcome by Inspection Visit type

SVA visits by type	Visits planned	Of those planned		Of those visited	
		Visits Cancelled	Visited	Access gained	No Access
Main Sample	1,644	107	1,537	1298	239
Re-inspection	4	0	4	4	0
Total	1,648	107	1,541	1,302	239
Percentages		6.5%	93.5%	84.5 %	15.5%

Table 2: No Access performance per Supplier Company Group

At Visit Supplier Company Group	Visits Planned	Accepted	No Access	%age No Access
SUPP	1		1	100.0%
SUPP	3	1	2	66.7%
SUPP	2	1	1	50.0%
SUPP	2	1	1	50.0%
SUPP	27	18	9	33.3%
SUPP	71	52	19	26.8%
SUPP	304	229	75	24.7%
SUPP	174	134	40	23.0%
SUPP	18	15	3	16.7%
SUPP	19	16	3	15.8%
SUPP	110	94	16	14.5%
SUPP	7	6	1	14.3%
SUPP	23	20	3	13.0%
SUPP	41	36	5	12.2%
SUPP	78	69	9	11.5%
SUPP	10	9	1	10.0%
SUPP	52	47	5	9.6%
SUPP	144	131	13	9.0%
SUPP	250	229	21	8.4%
SUPP	184	173	11	6.0%
SUPP	8	8	0	0.0%
SUPP	3	3	0	0.0%
SUPP	2	2	0	0.0%
SUPP	2	2	0	0.0%
SUPP	5	5	0	0.0%
SUPP	1	1	0	0.0%

Table 3: No access to CT/VT rating plates by Supplier Company Group

At Visit Supplier Company Group	Inspections Affected	Total Inspections	% of Inspections Affected
SUPP	1	0	100%
SUPP	1	0	100%
SUPP	1	0	100%
SUPP	1	0	100%
SUPP	2	0	100%
SUPP	1	0	100%
SUPP	1	0	100%
SUPP	3	5	60%
SUPP	1	2	50%
SUPP	5	10	50%
SUPP	34	78	44%
SUPP	5	15	33%
SUPP	85	304	28%
SUPP	5	18	28%
SUPP	14	52	27%
SUPP	7	26	27%
SUPP	5	19	26%
SUPP	7	27	26%
SUPP	6	24	25%
SUPP	17	71	24%
SUPP	31	144	22%
SUPP	37	174	21%
SUPP	38	184	20%
SUPP	46	250	18%
SUPP	19	110	17%
SUPP	1	7	14%
SUPP	1	8	13%

7.2.2 CDCC performance

Table 4: CDCC summary for those SVA Inspection Visits where access has been provided

Visit Type	Not Performed	Compliant	Non-compliant	Metering Systems accessed
Main Sample	7	1283	8	1298
Re-inspection	0	4	0	4
Total	7	1,287	8	1,302

7.2.3 SVA non-compliances identified during the 2018/19 audit year

Table 5: Number and % of SVA Inspection Visits where non-compliances are identified by Category

Visit Type	%	Number of Visits	No NCs	Has Cat1	Has Cat2	Has NC	Has Observations
Main Sample	80.0%	1051			✓		
Main Sample	16.0%	211	✓				
Main Sample	1.5%	19		✓	✓		
Main Sample	0.5%	7			✓	✓	
Main Sample	0.3%	4			✓	✓	
Main Sample	0.4%	5			✓		✓
Main Sample	0.07%	1		✓	✓	✓	
Main Sample	0.07%	1		✓	✓	✓	
Re-inspection	0.08%	4			✓		

Table 6: Summary SVA Main, Re-inspection Specific and Target Sample Category 1 non-compliances by Supplier and HHMOA

Supplier	HHMOA	1.01	1.02	1.03	1.04	1.06	Total
SUPP	HHMO		1		1		2
SUPP	HHMO		1				1
SUPP	HHMO		1				1
SUPP	HHMO		2				2
SUPP	HHMO				1		1
SUPP	HHMO			1			1
SUPP	HHMO				1		1
SUPP	HHMO		1				1
SUPP	HHMO				1		1
SUPP	HHMO				1		1
SUPP	HHMO		1	1			2
SUPP	HHMO			1			1
SUPP	HHMO		1				1
SUPP	HHMO		1				1
SUPP	HHMO	1			2		3
SUPP	HHMO			1			1
Total		1	9	4	7	0	21

7.2.4 Potential Settlement impacting materiality calculations for Category 1 non-compliances identified.

Table 7 data is an indication of materiality impact that could result from those Category 1 non-compliances identified in the SVA market. Potential metered error volumes are calculated by ELEXON.

Table 7: SVA Inspection Visits where there has been a material error identified

Visit Reference	Potential metered Errors MWh	Non-compliance status
XXXX	TBC	Rectified During Inspection Visit
XXXX	0	Resolved
XXXX	TBC	Non-Compliance Outstanding
XXXX	0	Resolved
XXXX	0	Resolved
XXXX	£102,689.82	Resolved
XXXX	0	Resolved
XXXX	0	Rectified Pending Confirmation
XXXX	0	Resolved
XXXX	-£347,832.06	Resolved
XXXX	0	Rectified During Inspection Visit
XXXX	0	Rectified During Inspection Visit
XXXX	TBC	Non-Compliance Outstanding
XXXX	0	Resolved
XXXX	0	Resolved
XXXX	TBC	Non-Compliance Outstanding
XXXX	TBC	Non-Compliance Outstanding
XXXX	TBC	Rectified Pending Confirmation
XXXX	0	Resolved
XXXX	0	Resolved
XXXX	TBC	Non-Compliance Outstanding
Total	-£245,142.24	

7.2.5 Rectification of Category 1 non-compliances

Table 8: SVA Main, Re-inspection, Specific and Target Sample Category 1 non-compliances average number of days to resolution

Notified Month	Number of NCs Identified	Average WD to resolve				
		1.01	1.02	1.03	1.04	1.06
Apr 2018	0	0	0	0	0	0
May 2018	3	0	1	101	0	0
Jun 2018	2	0	66	0	0	0
Jul 2018	1	0	0	0	64	0
Aug 2018	6	19	0	17	37	0
Sep 2018	3	0	33	27	0	0
Oct 2018	0	0	0	0	0	0
Nov 2018	2	0	0	0	0	0
Dec 2018	1	0	0	0	0	0
Jan 2019	3	0	31	0	0	0
Feb 2019	0	0	0	0	0	0
Mar 2019	0	0	0	0	0	0
Total identified	21	1	9	4	7	0
Unresolved	8	0	4	0	4	0
Resolved	13	1	5	4	3	0
Average days to resolve	30	19	26	36	34	0

7.2.6 Category 2 non-compliances

Table 9: Summary of SVA Category 2 (non-cert) non-compliances by Supplier

Supplier	2.01	2.02	2.03	2.08	2.09	2.10	2.11	2.13	2.14	Total
SUPP	10	4			2	5	10	56	5	92
SUPP	7	3	4			2	5	42	4	67
SUPP	5	3	1		1	2	2	31	10	55
SUPP	5	2	5			2	4	24	7	49
SUPP			1		1		4	30	5	41
SUPP	2	2	1		2		3	25	2	37
SUPP	3	1	2		1	3	1	13	1	25
SUPP	1		1		1	2		18	2	25
SUPP		1				2	4	13	1	21
SUPP			2		1	1	1	9	1	15
SUPP	1	1	1		1	4	2	3		13
SUPP			2		1			7	1	11
SUPP		1				1		7		9
SUPP						2		3	1	6
SUPP						1	1	1		3
SUPP	1						2			3
SUPP									2	2
SUPP								1	1	2
SUPP							1	1		2
SUPP									1	1
SUPP								1		1
SUPP								1		1
SUPP										0
SUPP										0
Total	35	18	20	0	11	27	40	286	44	481

Table 10: Summary of SVA category 2 (non-cert) non-compliances by HHMOA

HHMOA	2.01	2.02	2.03	2.08	2.09	2.10	2.11	2.13	2.14	Total
HHMO	11	8			1	9	11	68	18	126
HHMO	1	3	9		3	1	7	94	4	122
HHMO	1		2		1		4	55	3	66
HHMO	6	3	3			1	4	21	3	41
HHMO	1		2			9	6	5	7	30
HHMO	1	1			1	1	2	21	1	28
HHMO	4	1			3		3	5	4	20
HHMO	3	1	3		2	3	1	4	1	18
HHMO	2	1					1	11		15
HHMO	1					3	1		2	7
HHMO	4		1					1	1	7
HHMO								1		1
Total	35	18	20		11	27	40	286	44	481

Table 11: Summary of SVA category 2 (cert related) non-compliances by Supplier

Supplier Company Group	2.06	2.15	2.15L	2.15M	2.16	2.17	Total
SUPP	102	150	12	12	132	72	480
SUPP	81	139	11	16	105	67	419
SUPP	65	95	10	13	77	59	319
SUPP	54	87	2	4	87	54	288
SUPP	43	70	8	10	50	31	212
SUPP	36	50	6	5	35	40	172
SUPP	34	40	4	5	50	20	153
SUPP	24	38	4	5	29	22	122
SUPP	21	18	6	10	26	5	86
SUPP	17	26	4	3	19	15	84
SUPP	11	11	3	4	13	10	52
SUPP	10	7	3	3	17	3	43
SUPP	9	11	1		9	6	36
SUPP	6	10	1	2	7	9	35
SUPP	5	5	1	1	8	5	25
SUPP	4	6			3	2	15
SUPP	3	3		1	4	3	14
SUPP	2	4				6	12
SUPP	3	3			2	3	11
SUPP	1	1				1	3
SUPP	2	1					3
SUPP		1			2		3
SUPP	1						1
SUPP		1					1
Total	534	777	76	94	675	433	2,589

Table 12: Summary of SVA category 2 (cert related) non-compliances by HHMOA

HHMOA	2.06	2.15	2.15L	2.15M	2.16	2.17	Total
HHMO	100	146	11	14	112	101	484
HHMO	71	145	9	11	108	44	388
HHMO	81	77	32	36	87	62	375
HHMO	84	98	11	12	118	32	355
HHMO	44	89	4	4	66	47	254
HHMO	49	67	3	5	64	47	235
HHMO	41	68		2	57	24	192
HHMO	42	40	2	5	38	26	153
HHMO	13	21	1	2	20	16	73
HHMO	3	11	3	3	4	21	45
HHMO	6	13			1	11	31
HHMO		2				2	4
Total	534	777	76	94	675	433	2,589

7.3 CVA Audits

7.3.1 Appointments planned and cancelled

Table 13: Total number of CVA Inspection Visits planned and outcome by Inspection Visit type

CVA Visits by Type	Visits Planned	Of those planned		Of those visited	
		Visits Cancelled	Visited	Access Gained	No Access
Main Sample	69	5	64	63	1
Targeted	4	0	4	4	0
Re-inspection	1	0	1	1	0
Total	74	5	69	68	1
Percentages		6.7%	93.3%	98.6%	1.4%

Table 14: Total number of individual CVA circuits planned and outcome by Inspection Visit type

CVA Circuits by Type	Circuits Planned	Of those planned		Of those visited	
		Cancelled	Visited	Access Gained	No Access
Main Sample	233	20	213	197	16
Targeted	14	0	14	12	2
Re-inspection	2	0	2	2	0
Total	249	20	229	211	18
Percentages		8%	92%	92%	8%

7.3.2 CDCC Performance

Table 15: CDCC summary for those CVA Inspection Visits where access has been provided

Visit Type	Compliant	Non-compliant	Check not performed	Metering Systems accessed
Main Sample	55	0	8	63
Targeted	4	0	0	4
Re-inspection	1	0	0	1
Total	60	0	8	68

Table 16: CDCC summary for those individual CVA circuits where access has been provided

Visit Type	Compliant	Non-compliant	Check not performed	Metering Systems accessed
Main Sample	166	2	29	197
Targeted	12	0	0	12
Re-inspection	2	0	0	2
Total	180	2	29	211

7.3.3 CVA non-compliances identified during 2018/19 audit year

Table 17: Number and % of CVA Inspection Visits where non-compliances were identified by category

Visit Type	%	Number of Visits	No NCs	Has Cat1	Has Cat2	Has NC	Has Observations
Main Sample	62%	130			✓		
Main Sample	20%	43					
Main Sample	8%	17					
Main Sample	4%	8			✓		
Main Sample	0.95%	2		✓	✓	✓	
Re-inspection	0.95%	2			✓		
Target	3%	7			✓		
Target	2%	4					
Target	0.5%	1		✓	✓		

Table 18: Summary of CVA Category 1 and 2 non-compliances identified during the 2018/19 audit year

Non-compliance identified	1.02	1.03	1.06	2.01	2.02	2.03	2.06	2.10	2.11	2.13	2.15	2.16	2.17	Total
Meter Error/failure	1		2											3
Commissioning incomplete, incorrect or not provided											113			113
Overall accuracy may not be being maintained							84							84
VT certificates not provided												84		84
Miscellaneous										76				76
CT certificates not provided												71		71
Alarms								10						10
Meter calibration certificate not provided													53	53
Valid Aggregation Rule not received/incorrect										6				6
Time drifts		2												2
Error in MTD's				1	14	33								48
Metering seals not intact									2					2
Total	1	2	2	1	14	33	84	10	2	82	113	155	53	552

7.3.4 Potential Settlement impacting non-compliance calculations

Table 19 data is an indication of materiality impact that could result from those Category 1 non-compliances identified in the CVA market. Error volumes are calculated by ELEXON.

Table 19: CVA Inspection Visits where there has been a material error identified

Visit Reference	Potential metered Errors MWh	Non-compliance status
XXXX	None to Report	Resolved
XXXX	None to Report	Resolved
XXXX	None to Report	Resolved
XXXX	None to Report	Resolved
XXXX	TBC	Resolved
Total		

8 Appendix 2 – Category 1 and 2 non-compliance descriptions

1.01 Inaccuracy of Standing Data (Key MTD fields) held by Data Collector

- Outstation serial number
- Meter ID (serial number)
- Outstation number of channels
- Measurement Quantity ID
- Pulse multiplier
- Channel configuration
- Outstation multiplier/Outstation channel multiplier
- Complex Site Supplementary Information Form (SVA only)

1.02 Metering Equipment Incorrect or Unsatisfactory

- Metering Equipment not functioning correctly
- Metering Equipment not programmed correctly
- Overall accuracy of Metering System not maintained
- Summation CTs used
- Correct Energy Measurement Check (Primary/Secondary conductor prevailing load test) indicates an error in the Metered Volume
- Measurement Transformers not located at Defined Metering Point

1.03 Timing Error (Major)

- Outstation clock outside agreed tolerance

1.04 Measurement Transformer Ratios Physically Incorrect

- Measurement transformer ratios different from those set up in Meter (except for any difference being consistent with a measurement error compensation applied within the Metering Equipment)

1.05 Compensation Calculations Incorrect

- Meter compensation for Measurement Transformers Incorrectly applied or not applied
- Meter compensation for Power Transformers incorrectly applied or not applied

1.06 Miscellaneous

- Other non-compliance not covered elsewhere

2.01 Inaccuracy of Standing Data held by HHMOA

- Outstation serial number
- Meter ID (serial number)
- Outstation number of channels
- Measurement Quantity ID
- Meter Register Multiplier
- Pulse multiplier
- Channel configuration
- Outstation multiplier/Outstation channel multiplier
- Measurement Transformer Ratios
- Complex Site Supplementary Information Form (SVA only)

2.02 Inaccuracy of Standing Data (non-Key MTD fields) held by Data Collector

- Data Collector's Meter Technical Details do not match on site equipment due to recent Meter Exchange
- Other non-Key fields (e.g. Measurement Transformer Ratios, Meter Register Multiplier)

2.03 Non-provision of Standing Data

- Meter Technical Details not provided – HHMOA and Data Collector
- Complex Site Supplementary Information Form not provided (SVA only)

2.06 Metering Equipment Incorrect or Unsatisfactory

- Incorrect CoP applied
- Check Meter missing
- Main Meter missing, Check Meter present and accurate
- Voltage selection relay not installed/working when Summation CTs used
- Meter accuracy class incorrect
- CT accuracy class incorrect
- VT accuracy class incorrect
- Unapproved data format and protocol in use
- Possibility that overall accuracy of Metering System not maintained

2.07 Measurement Transformer and/or Meter Certificates¹⁷

- Certificates not provided
- Certificates do not match on-site equipment

2.08 Unsuitable Environment

- Environmental conditions likely to cause Metering Equipment failure

2.09 Inadequate Over-current Protection

- Insufficient discrimination between source and local fusing
- No local isolation
- Main and check Meters not separately fused
- Other Metering Equipment not separately fused
- Non-settlement Meters not separately fused

2.10 Separate Phase Failure Alarms not Installed or Inadequate/Failed – Local and Remote

- Alarm not fitted where required

¹⁷ Category 2.07 non-compliance was replaced by Category 2.16 and 2.17 in February 2009.

- Alarm not functioning

2.11 Inadequate Metering Equipment Integrity

- Settlement Metering Equipment not sealed
- Password functionality not included in Outstation

2.12 Metering Equipment Test Facilities

- Lack of adequate Metering Equipment test facilities

2.13 Miscellaneous

- Other non-compliance not covered elsewhere

2.14 Timing Error (Minor)

- Outstation clock outside agreed tolerance

2.15 Commissioning Records

- Commissioning records not provided
- Commissioning records incorrect
- Commissioning records incomplete
- Commissioning records not provided (LDSO)
- Commissioning records incorrect (LDSO)
- Commissioning records incomplete (LDSO)
- Commissioning records not provided (HHMOA)
- Commissioning records incorrect (HHMOA)
- Commissioning records incomplete (HHMOA)

2.16 Measurement Transformer Certificates not provided or incorrect

- Measurement Transformer Certificates not provided
- Measurement Transformer Certificates do not match site equipment

2.17 Meter Certificates not provided or incorrect

- Meter Certificates not provided
 - Meter Certificates do not match site equipment
-