

| | |
|----------------------------------|--|
| Report Number | TRN-16170 |
| Customer | DEKRA Certification B.V. |
| Contact | Jacob Nuesink |
| Product Type | Street Light |
| Test Purpose | UMS Energy Performance Test |
| Sales Order Ref | Q-LUX15-20258 |
| Works Order Number | WO-6817 |
| Test Item Reference | TI-11071 |
| LAB Test Method Reference | TES-20012 |
| Test Standards | LM-79-08 and Elexon UMS Charge Code process V4.0 |
| Lab Location Reference | Safety - UMS |
| Tested By | Steve Hunt |
| Date of Test | 18 December 2015 |
| Analysed by | Steve Hunt |
| Number of products tested | 5 |

Address: LUX-TSI Ltd.,
Pencoed Technology Park,
Pencoed, Bridgend,
CF35 5AQ, UK
Telephone: +44 (0) 1656 864618
Authorised by: Gareth Jones
Email: gjones@lux-tsi.com
Signed:



Date: 8 January 2016



Luxis60 6000lm 48x830 75dWv XiFp
ANTBLUE XXXX XXX C2 - Lightwell

Disclaimers

This report is for the exclusive use of LUX-TSI's Customer and is provided pursuant to the agreement between LUX-TSI and its Customer. LUX-TSI's responsibility and reliability are limited to the Terms and Conditions of the agreement. LUX-TSI assumes no liability to any other party, other than the Customer in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Customer is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the LUX-TSI name or one of its marks for the sale or advertisement of the tested material, product or service must be approved in writing by LUX-TSI.

The observations and test results in this report are relevant only to the sample tested. Opinions expressed and data supplied in this report, are given in good faith, and are based on the information provided by the Customer. This report does not remove the requirement for the Customer to obtain further independent advice and in particular to instruct a notified or competent body or person to carry out further evaluation work and/or testing. Accordingly, no warranty is given, nor is any term or condition to be implied, that the product, which is the subject of this report, complies with the requirements of any EU directives.



LUX-TSI is UKAS
Accredited to
ISO/IEC 17025

Nomenclature

Lamp Orientation described below relates to the position in which a lamp is designed to operate for maximum performance and safety, these include:

BD - Base Down (bulb is vertically positioned with the metal base at the bottom, glass up)

BU - Base Up (bulb is vertically positioned with the metal base at the top, glass hanging down)

HBD - Horizontal +15° to Base Down

H45 - Horizontal to -45° only

VBV - Vertical Base Up ±15°

VBD - Vertical Base Down ±15°

HBU - Base Up +/- 90° (bulb can be operated in a base up or horizontal position)

HOR - Horizontal Burn (bulb is positioned with the metal base parallel to the ground)

H75 - Horizontal +/- 75° (bulb should not be operated within 15° of vertical)

U - Universal Burn (burn can be operated in any position)

Test Equipment and Description

Yokogawa WT210 Power Analyser. Kikusui PCR2000M Stable AC Power Supply with PC control and data recording



The products under test are connected to the UMS Test system which has full data control and recording using Labview software. This allows full integration of the test equipment used - Kikusui AC Stable Power Supply, Yokogawa Power Analyser, Pico Temperature Logger and a LUX-TSI distribution control panel

| | |
|------------------------------|---|
| Product Name | Luxis60 6000lm 48x830 75dWv XiFp ANTBLUE XXXX XXX C2 - Lightwell |
| Part/Serial Number | See (Identifier) below |
| Type of Product | Street Light |
| Manufacturer | Philips |
| Date of Manufacturer | Unknkown |
| Base Type | Tile |
| Driver Type | Mains |
| Driver Model | XITANIUM FULL PROG 110W 1000 NLI C150 Xt |
| Light Engine Model | - |
| Operating Orientation | Base Up |
| Test Orientation | Base Up |
| Ambient Temperature | 23.2°C |
| Humidity | <65% RH |
| Thermal Management | Passive |
| Dimmable | Yes |
| Product Summary | The product is of a street lantern design with a Metal enclosure. The driver is situated within the enclosure and the Light engine fitted on underside of the product |

| Dimension | Sample | Luminous Opening |
|----------------|--------|------------------|
| Diameter/Width | 705 mm | 310 mm |
| Length | 370 mm | 244 mm |
| Height/Depth | 165 mm | 0 mm |

| Test Item | Identifier |
|-----------|------------|
| 11071A | 1 |
| 11071B | 2 |
| 11071C | 3 |
| 11071D | 4 |
| 11071E | 5 |

Test Conditions



| | Before Test | After Test |
|--|-------------|------------|
| AC Supply Voltage (V) | 249.95V | 249.89V |
| AC Supply Frequency (Hz) | 50Hz | 50Hz |
| Voltage RMS Summation of the Harmonic Components (THD) | 0.08% | 0.07% |


The test items were stabilised according to the electrical power stability of LM79-08. Stabilization is achieved when the difference in electrical power measurement is less than 0.5%. Each test item was stabilised at 250V.

Measurements were made with an ambient temperature of 25°C +/- 2°C. Measurements were taken only after sufficient time for thermal stabilisation has been allowed.

Test Results Summary

These are the summary graphs of the test results for all products tested. The raw results are on page 6 of this test report.





Power factors measured have a Lagging phase angle and therefore the driver has inductive properties.

Measurement Uncertainty

| Parameter | Uncertainty |
|---------------------------------|-----------------------|
| Voltage (300 V, 50/60 Hz) | $\pm 0.061 V_{rms}$ |
| Current (200 mA, 50/60Hz) | $\pm 0.07 mA_{rms}$ |
| Current (0.5 A, 50/60Hz) | $\pm 0.16 mA_{rms}$ |
| Current (5 A, 50/60Hz) | $\pm 0.0016 A_{rms}$ |
| Power (300 V, 200 mA, 50/60 Hz) | $\pm 0.032 W_{rms}$ |
| Power (300 V, 0.5 A, 50/60 Hz) | $\pm 0.09 W_{rms}$ |
| Power (300 V, 5 A, 50/60 Hz) | $\pm 0.0009 kW_{rms}$ |
| Frequency (50/60 Hz) | $\pm 0.001 Hz$ |
| Power Factor | $\pm 0.0006 PF$ |

Measurements of power of 0.50W or greater are made with an uncertainty of less than or equal to 2% at the 95% confidence level. Measurements of power less than 0.50W are made with an uncertainty of less than or equal to 0.01W at the 95% confidence level.

Full Test Results

| Test Item | Voltage (V) | Current (mA) | Electrical Power (W) | Ambient Temp (°C) | Peak Power (VA) | Power Factor | Leading / Lagging |
|-----------|-------------|--------------|----------------------|-------------------|-----------------|--------------|-------------------|
| A | 249.96 | 204.47 | 48.49 | 23.15 | 51.11 | 0.949 | Lagging |
| B | 249.94 | 206.76 | 49.17 | 23.12 | 51.68 | 0.951 | Leading |
| C | 249.95 | 207.92 | 49.47 | 23.16 | 51.97 | 0.952 | Leading |
| D | 250.02 | 204.63 | 48.63 | 23.31 | 51.16 | 0.951 | Leading |
| E | 249.95 | 204.45 | 48.57 | 23.27 | 51.10 | 0.950 | Leading |
| A | 239.93 | 211.09 | 48.46 | 23.06 | 50.65 | 0.957 | Lagging |
| B | 239.92 | 213.62 | 49.16 | 23.11 | 51.25 | 0.959 | Leading |
| C | 239.93 | 214.67 | 49.41 | 23.10 | 51.50 | 0.959 | Leading |
| D | 239.95 | 211.18 | 48.56 | 22.98 | 50.67 | 0.958 | Leading |
| E | 239.93 | 211.01 | 48.51 | 23.01 | 50.63 | 0.958 | Leading |
| A | 229.89 | 218.96 | 48.51 | 23.10 | 50.34 | 0.964 | Lagging |
| B | 229.94 | 221.14 | 49.11 | 23.06 | 50.85 | 0.966 | Leading |
| C | 229.96 | 222.37 | 49.40 | 23.06 | 51.14 | 0.966 | Leading |
| D | 229.90 | 218.51 | 48.47 | 23.03 | 50.23 | 0.965 | Leading |
| E | 229.89 | 218.91 | 48.57 | 23.11 | 50.33 | 0.965 | Leading |
| A | 219.87 | 227.12 | 48.44 | 22.98 | 49.94 | 0.970 | Lagging |
| B | 219.88 | 229.69 | 49.07 | 23.07 | 50.50 | 0.972 | Leading |
| C | 219.88 | 230.74 | 49.30 | 22.94 | 50.73 | 0.972 | Leading |
| D | 219.89 | 226.93 | 48.45 | 22.96 | 49.90 | 0.971 | Leading |
| E | 219.95 | 227.48 | 48.59 | 22.98 | 50.03 | 0.971 | Leading |
| A | 209.89 | 236.52 | 48.42 | 22.93 | 49.64 | 0.975 | Lagging |
| B | 209.87 | 239.06 | 49.00 | 22.92 | 50.17 | 0.977 | Leading |
| C | 209.86 | 240.27 | 49.26 | 22.93 | 50.42 | 0.977 | Leading |
| D | 209.86 | 236.56 | 48.47 | 23.00 | 49.64 | 0.976 | Leading |
| E | 209.87 | 236.90 | 48.54 | 22.99 | 49.72 | 0.976 | Leading |

Test Item Photographs

TI-11071

Images of Product(s) under test includes (where possible) labelling, Driver and Light engine details



Top of Test Item



Front Face of Test Item



Inside Driver Compartment including driver




Close up of Driver

Driver in Situ



Light Engine

Appendix 1: Test item set-up

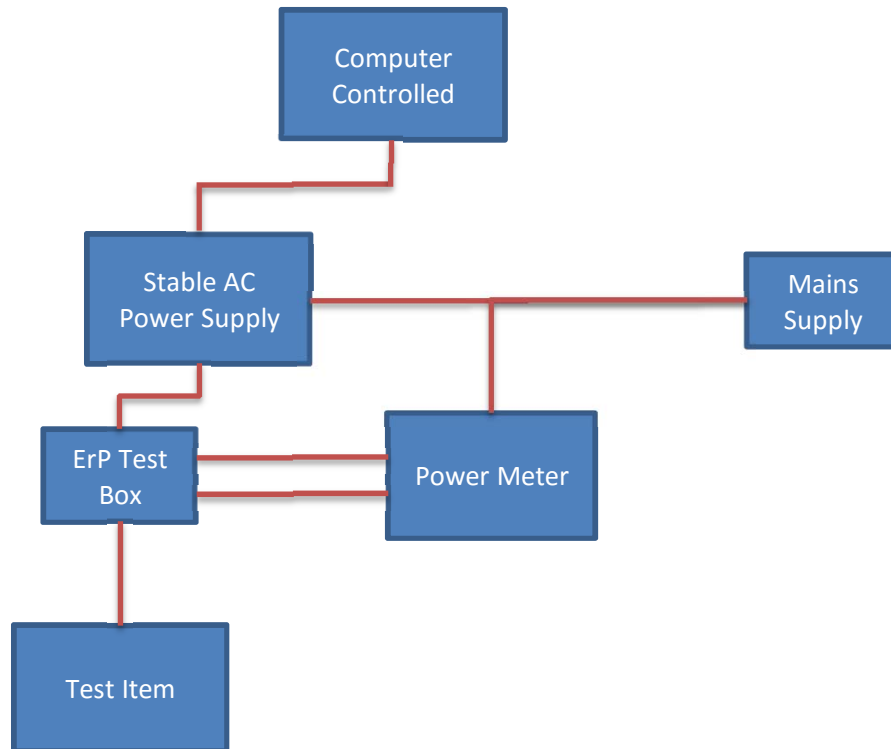

----- END OF REPORT -----



The UL Preferred Partner mark is used under license from UL LLC. This e-mail and any attachments are confidential and intended solely for the use of the recipient(s) to whom they are addressed. LUX-TSI Ltd is a company registered in England and Wales. Registered number: 07227351. Registered office: Unit 1b Pencoed Technology Park, Pencoed, Bridgend, CF35 5AQ.