

T e s t R e p o r t

Report No : U10019C

Client: : LED Group
Western Retail Park
Nangor Road
Dublin 12
Ireland

Description : Eagle 14W LED

Manufacturer : Not disclosed

Type/Model : REEM01540-01

Test Specification : Measurement of power consumption in accordance with the
'Unmetered Supplies Operational Information Document' –
Version 17.0 (15/03/2017)

Date Testing Started : 30/04/2018

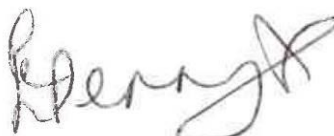
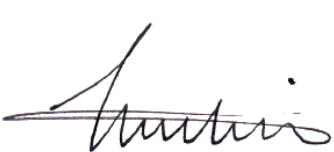
Conclusion : Refer to body of report

Date of Issue : 23/05/2018

Date of Expiry : 22/05/2023

Tested by: E. PERRY
Position: Technical Administrator
Apprentice

Approved: T. MALIK
Position: Operations Manager

INTRODUCTION

LED Group has supplied the product identified in table 1 for measurement of power consumption in accordance with the 'Unmetered Supplies Operational Information Document' – Version 17.0 (15/03/2017).

PRODUCT DETAILS

Table 1. Test Sample Details

Product Description	Eagle 14W LED
Model No.	REEM01540-01
Number of Samples	Five
Condition on Receipt	Good
Nominal Dimensions	Ø – 330mm; H – 91mm
Product Supply Requirement	220-240V AC, 50/60Hz
Lamp Type and Power	LED, 14W
Sampling Method: Test samples selected and supplied by client, no sampling method specified by client.	

The customer has declared that the equipment load does not vary with ambient temperature.

Continued on following page

RESULTS

Table 2. *Wattage and VA results for KM01540-01E*

Operating Mode	100%				
Watts					
Voltage	Sample Number				
	1	2	3	4	5
210	12.31	12.19	12.53	12.49	12.50
220	12.40	12.27	12.65	12.55	12.67
230	12.49	12.32	12.74	12.59	12.77
240	12.60	12.39	12.83	12.66	12.88
250	12.79	12.53	13.01	12.81	13.06
VA					
Voltage	Sample Number				
	1	2	3	4	5
210	12.67	12.56	12.88	12.83	12.86
220	12.83	12.70	13.05	12.95	13.08
230	12.96	12.81	13.19	13.04	13.23
240	13.13	12.95	13.34	13.18	13.41
250	13.38	13.16	13.58	13.39	13.63
Power Factor					
Voltage	Sample Number				
	1	2	3	4	5
210	0.97	0.97	0.97	0.97	0.97
220	0.97	0.97	0.97	0.97	0.97
230	0.96	0.96	0.97	0.97	0.97
240	0.96	0.96	0.96	0.96	0.96
250	0.96	0.95	0.96	0.96	0.96
Ambient Temperature During Test (°C)			24.8		
PF Leading/Lagging			Leading		

Continued on following page

DEVIATION(S) FROM TEST STANDARD

No reported deviations from test standard.

MEASUREMENT UNCERTAINTY

The following expanded uncertainties apply to the measurements shown in the results;

True Power (W): $\pm 0.69\%$, Apparent Power (VA): $\pm 0.61\%$

The reported expanded uncertainty is based on a standard uncertainty multiplied by a coverage factor $k=2$, providing a coverage probability of approximately 95%. The uncertainty evaluation has been carried out in accordance with UKAS requirements.

Continued on following page

ILLUSTRATION




Figure 1. *Product image*

End